

LEED 2009 FOR

**NEW CONSTRUCTION
AND MAJOR RENOVATIONS**

**WITH ALTERNATIVE COMPLIANCE PATHS
FOR PROJECTS OUTSIDE THE U.S.**

For Public Use and Display

LEED 2009 for New Construction and Major Renovations Rating System
With Alternative Compliance Paths For Projects Outside the U.S.

USGBC Member Approved November 2008 (Updated November 2011)



PREFACE FROM USGBC

The built environment has a profound impact on our natural environment, economy, health, and productivity. Breakthroughs in building science, technology, and operations are now available to designers, builders, operators, and owners who want to build green and maximize both economic and environmental performance.

Through the LEED® green building certification program, the U.S. Green Building Council (USGBC) is transforming the built environment. The green building movement offers an unprecedented opportunity to respond to the most important challenges of our time, including global climate change, dependence on non sustainable and expensive sources of energy, and threats to human health. The work of innovative building professionals is a fundamental driving force in the green building moment. Such leadership is a critical component to achieving USGBC's mission of a sustainable built environment for all within a generation.

USGBC MEMBERSHIP

USGBC's greatest strength is the diversity of our membership. USGBC is a balanced, consensus based nonprofit with more than 18,000 member companies and organizations representing the entire building industry. Since its inception in 1993, USGBC has played a vital role in providing a leadership forum and a unique, integrating force for the building industry. USGBC's programs have three distinguishing characteristics:

Committee-based

The heart of this effective coalition is our committee structure, in which volunteer members design strategies that are implemented by staff and expert consultants. Our committees provide a forum for members to resolve differences, build alliances, and forge cooperative solutions for influencing change in all sectors of the building industry.

Member-driven

Membership is open and balanced and provides a comprehensive platform for carrying out important programs and activities. We target the issues identified by our members as the highest priority. We conduct an annual review of achievements that allows us to set policy, revise strategies, and devise work plans based on members' needs.

Consensus-focused

We work together to promote green buildings, and in doing so, we help foster greater economic vitality and environmental health at lower costs. We work to bridge ideological gaps between industry segments and develop balanced policies that benefit the entire industry.

Contact the U.S. Green Building Council
2101 L Street, NW
Suite 500
Washington, DC 20037
(800) 795-1747 Office
(202) 828-5110 Fax
www.usgbc.org

COPYRIGHT

Copyright © 2009 by the U.S. Green Building Council, Inc. All rights reserved.

The U.S. Green Building Council, Inc. (USGBC®) devoted significant time and resources to create this LEED® Rating System. USGBC authorizes individual use of the LEED Rating System. In exchange for this authorization, the user agrees:

1. to retain all copyright and other proprietary notices contained in the LEED Rating System,
2. not to sell or modify the LEED Rating System, and
3. not to reproduce, display, or distribute the LEED Rating System in any way for any public or commercial purpose.

Unauthorized use of the LEED Rating System violates copyright, trademark, and other laws and is prohibited.

DISCLAIMER

None of the parties involved in the funding or creation of the LEED Rating System, including the USGBC, its members, its members, volunteers, or contractors, assume any liability or responsibility to the user or any third parties for the accuracy, completeness, or use of or reliance on any information contained in the LEED Rating System, or for any injuries, losses, or damages (including, without limitation, equitable relief) arising from such use or reliance. Although the information contained in the LEED Rating System is believed to be reliable and accurate, all materials set forth within are provided without warranties of any kind, either express or implied, including but not limited to warranties of the accuracy or completeness of information or the suitability of the information for any particular purpose.

As a condition of use, the user covenants not to sue and agrees to waive and release the U.S. Green Building Council, its members, volunteers, and contractors from any and all claims, demands, and causes of action for any injuries, losses, or damages (including, without limitation, equitable relief) that the user may now or hereafter have a right to assert against such parties as a result of the use of, or reliance on, the LEED Rating System.

U.S. Green Building Council
2101 L Street, NW
Suite 500
Washington, DC 20037

TRADEMARKS

USGBC®, U.S. Green Building Council® and LEED® are registered trademarks of the U.S. Green Building Council.

ACKNOWLEDGMENTS

The LEED 2009 Rating System has been made possible only through the efforts of many dedicated volunteers, staff members, and others in the USGBC community. The Rating System improvement work was managed and implemented by USGBC staff and included review and input by many Technical Advisory Group (TAG) members with oversight by the LEED Steering Committee. We extend our deepest gratitude to all of our LEED committee members who participated in the development of this rating system, for their tireless volunteer efforts and constant support of USGBC's mission:

LEED Steering Committee

Scot Horst, Chair, LSC	Horst, Inc
Joel Ann Todd, Vice-Chair, LSC	Joel Ann Todd
Muscoe Martin	M2 Architecture
Stuart Carron	JohnsonDiversey, Inc.
Holley Henderson	H2 Ecodesign, LLC
Christine Magar	Greenform
Kristin Shewfelt	Architectural Energy Corporation
Jessica Millman	Agora DC
Bryna Dunn	Moseley Architects
Neal Billetdeaux	JJR
Greg Kats	Managing Good Energies
Mark Webster	Simpson Gumpertz & Heger
Bob Thompson	EPA Indoor Environment Management Branch
Malcolm Lewis	Constructive Technologies Group, Inc.
John Boecker	7Group
Sara O'Mara	Choate Construction Company
Alex Zimmerman	Rep Canada Green Building Council
Ian Theaker	Rep Canada Green Building Council

Sustainable Sites TAG

Bryna Dunn, Chair	Moseley Architects
Stewart Comstock, Vice-Chair	Maryland Department of the Environment
Michele Adams	Cahill Associates
Gina Baker	Burt Hill
Ted Bardacke	Global Green USA
Stephen Benz	Sasaki
Mark Brumbaugh	Brumbaugh & Associates
Laura Case	Emory University Campus Services
Zach Christeson	the HOK Planning Group
Jay Enck	Commissioning & Green Building Services
Ron Hand	E/FECT. Sustainable Design Solutions
Richard Heinisch	Acuity Lighting Group
Michael Lane	Lighting Design Lab
Marita Roos	HNTB
Zolna Russell	Hord Coplan Macht, Inc.
Alfred Vick	Ecos Environmental Design, Inc.

Water Efficiency TAG

Neal Billetdeaux, Chair	JJR
John Koeller, Vice-Chair	Alliance for Water Efficiency
David Carlson	Columbia University
Bill Hoffman	H.W. Hoffman and Associates, LLC
Geoff Nara	Civil & Environmental Consultants
Stephanie Tanner	U.S. Environmental Protection Agency
Daniel Yeh	University of South Florida
David Bracciano	Tampa Bay Water
Robert Rubin	NCSU-BAE and McKim & Creed
Winston Huff	SSR Engineers
Robert Benazzi	Jaros Baum & Bolles
Gunnar Baldwin	TOTO USA, INC
Heather Kinkade	Forgotten Rain, LLC
Shabbir Rawalpindiwala	Kohler Company
Bill Wall	Clivus New England, Inc.

Energy & Atmosphere TAG

Greg Kats, Chair	GoodEnergies
Marcus Sheffer, Vice-Chair	7group
Drury Crawley	US Department of Energy
Jay Enck	Commissioning & Green Building Solutions, Inc.
Ellen Franconi	IPMVP and AEC
Mark Frankel	New Buildings Institute
Nathan Gauthier	Harvard Green Campus Initiative
Rusty Hodapp	Dallas/Fort Worth, Energy & Transportation Management
John Hogan	City of Seattle Department of Planning & Development
Bion Howard	Building Environmental Science and Technology
Dan Katzenberger	Engineering, Energy, and the Environment
Bob Maddox	Sterling Planet
Brenda Morawa	BVM Engineering, Inc.
Erik Ring	LPA, Inc.
Michael Rosenberg	Oregon Department of Energy
Mick Schwedler	Trane
Gord Shymko	IPMVP and G.F. Shymko & Associates
Gail Stranske	CTG Energetics
Michael Zimmer	Thompson Hine LLP

Materials & Resources TAG

Mark Webster, Chair	Simpson Gumpertz & Heger
Steven Baer, Vice Chair	Five Winds International
Paul Bertram	NAIMA
Chris Dixon	NBBJ
Ann Edminster	Design AVenues
Lee Gros	Lee Gros Architect and Artisan, Inc
Theresa Hogerheide-Reusch	Reusch Design Services
Nadav Malin	BuildingGreen, LLC.

LEED 2009 FOR NEW CONSTRUCTION AND MAJOR RENOVATIONS RATING SYSTEM
WITH ALTERNATIVE COMPLIANCE PATHS FOR PROJECTS OUTSIDE THE U.S.

Nancy Malone	Siegel & Strain Architects
Kirsten Ritchie	Gensler
Wayne Trusty	Athena Sustainable Materials Institute
Denise Van Valkenburg	MASCO Retail Cabinet Group
Gabe Wing	Herman Miller, Inc.

Indoor Environmental Quality TAG

Bob Thompson, Chair	EPA Indoor Environment Management Branch
Steve Taylor, Vice-Chair	Taylor Engineering
Nancy Clanton	Clanton and Associates
Alexis Kurtz	Ove Arup & Partners
George Loisos	Loisos+ Ubelohde
Prasad Vaidya	The Weidt Group
Daniel Bruck	BRC Acoustics & Tech.
David Lubman	David Lubman & Associates
Charles Salter	Salter Associates
Ozgem Ornektekin	DMJM Harris
Jude Anders	Shoreline Concepts, LLC
Brian Cloward	Mithun Architects+Designers+Planners
Larry Dykhuis	Herman Miller, Inc
Francis (Bud) Offerman	Indoor Environmental Engineering
Christopher Schaffner	The Green Engineer
Dennis Stanke	Trane Company

The LEED 2009 for New Construction Rating System builds on the work of those who helped create previous versions:

LEED for New Construction Version 2.2 Core Committee

James H. Goldman, Chair	Turner Construction
Tom Scarola, Vice-Chair	Tishman Speyer Properties
Lee Burgett	Trane Company
Craig Kneeland	NYSERDA
Joe Higgins	Fidelity Real Estate Company
Harry Gordon	Burt Hill Kosar Rittelmann Associates
Muscoe Martin	Wallace Roberts & Todd, LLC
Chris Dixon	Mithun
Bill Odell	HOK Architects
Chris Schaffner	The Green Engineer
Wayne Trusty	Athena Sustainable Materials Institute
Jerry Yudelson	Greenway Consulting Group, LLC
Charlotte Matthews	Bovis Lend Lease
John McFarland	WorkingBuildings LLC
Prasad Vaidya	The Weidt Group
Aalok Deshmuk	The Rocky Mountain Institute

LEED 2009 FOR NEW CONSTRUCTION AND MAJOR RENOVATIONS PROJECT CHECKLIST

Sustainable Sites

26 Possible Points

<input checked="" type="checkbox"/>	Prerequisite 1	Construction Activity Pollution Prevention	Required
<input type="checkbox"/>	Credit 1	Site Selection	1
<input type="checkbox"/>	Credit 2	Development Density and Community Connectivity	5
<input type="checkbox"/>	Credit 3	Brownfield Redevelopment	1
<input type="checkbox"/>	Credit 4.1	Alternative Transportation—Public Transportation Access	6
<input type="checkbox"/>	Credit 4.2	Alternative Transportation—Bicycle Storage and Changing Rooms	1
<input type="checkbox"/>	Credit 4.3	Alternative Transportation—Low-Emitting and Fuel-Efficient Vehicles	3
<input type="checkbox"/>	Credit 4.4	Alternative Transportation—Parking Capacity	2
<input type="checkbox"/>	Credit 5.1	Site Development—Protect or Restore Habitat	1
<input type="checkbox"/>	Credit 5.2	Site Development—Maximize Open Space	1
<input type="checkbox"/>	Credit 6.1	Stormwater Design—Quantity Control	1
<input type="checkbox"/>	Credit 6.2	Stormwater Design—Quality Control	1
<input type="checkbox"/>	Credit 7.1	Heat Island Effect—Nonroof	1
<input type="checkbox"/>	Credit 7.2	Heat Island Effect—Roof	1
<input type="checkbox"/>	Credit 8	Light Pollution Reduction	1

Water Efficiency

10 Possible Points

<input checked="" type="checkbox"/>	Prerequisite 1	Water Use Reduction	Required
<input type="checkbox"/>	Credit 1	Water Efficient Landscaping	2-4
<input type="checkbox"/>	Credit 2	Innovative Wastewater Technologies	2
<input type="checkbox"/>	Credit 3	Water Use Reduction	2-4

Energy and Atmosphere

35 Possible Points

<input checked="" type="checkbox"/>	Prerequisite 1	Fundamental Commissioning of Building Energy Systems	Required
<input checked="" type="checkbox"/>	Prerequisite 2	Minimum Energy Performance	Required
<input checked="" type="checkbox"/>	Prerequisite 3	Fundamental Refrigerant Management	Required
<input type="checkbox"/>	Credit 1	Optimize Energy Performance	1–19
<input type="checkbox"/>	Credit 2	On-site Renewable Energy	1–7
<input type="checkbox"/>	Credit 3	Enhanced Commissioning	2
<input type="checkbox"/>	Credit 4	Enhanced Refrigerant Management	2
<input type="checkbox"/>	Credit 5	Measurement and Verification	3
<input type="checkbox"/>	Credit 6	Green Power	2

Materials and Resources

14 Possible Points

<input checked="" type="checkbox"/>	Prerequisite 1	Storage and Collection of Recyclables	Required
<input type="checkbox"/>	Credit 1.1	Building Reuse—Maintain Existing Walls, Floors and Roof	1-3
<input type="checkbox"/>	Credit 1.2	Building Reuse—Maintain Existing Interior Nonstructural Elements	1
<input type="checkbox"/>	Credit 2	Construction Waste Management	1-2
<input type="checkbox"/>	Credit 3	Materials Reuse	1-2
<input type="checkbox"/>	Credit 4	Recycled Content	1-2

LEED 2009 FOR NEW CONSTRUCTION AND MAJOR RENOVATIONS RATING SYSTEM WITH ALTERNATIVE COMPLIANCE PATHS FOR PROJECTS OUTSIDE THE U.S.

<input type="checkbox"/>	Credit 5	Regional Materials	1-2
<input type="checkbox"/>	Credit 6	Rapidly Renewable Materials	1
<input type="checkbox"/>	Credit 7	Certified Wood	1

Indoor Environmental Quality

15 Possible Points

<input checked="" type="checkbox"/>	Prerequisite 1	Minimum Indoor Air Quality Performance	Required
<input checked="" type="checkbox"/>	Prerequisite 2	Environmental Tobacco Smoke (ETS) Control	Required
<input type="checkbox"/>	Credit 1	Outdoor Air Delivery Monitoring	1
<input type="checkbox"/>	Credit 2	Increased Ventilation	1
<input type="checkbox"/>	Credit 3.1	Construction Indoor Air Quality Management Plan—During Construction	1
<input type="checkbox"/>	Credit 3.2	Construction Indoor Air Quality Management Plan—Before Occupancy	1
<input type="checkbox"/>	Credit 4.1	Low-Emitting Materials—Adhesives and Sealants	1
<input type="checkbox"/>	Credit 4.2	Low-Emitting Materials—Paints and Coatings	1
<input type="checkbox"/>	Credit 4.3	Low-Emitting Materials—Flooring Systems	1
<input type="checkbox"/>	Credit 4.4	Low-Emitting Materials—Composite Wood and Agrifiber Products	1
<input type="checkbox"/>	Credit 5	Indoor Chemical and Pollutant Source Control	1
<input type="checkbox"/>	Credit 6.1	Controllability of Systems—Lighting	1
<input type="checkbox"/>	Credit 6.2	Controllability of Systems—Thermal Comfort	1
<input type="checkbox"/>	Credit 7.1	Thermal Comfort—Design	1
<input type="checkbox"/>	Credit 7.2	Thermal Comfort—Verification	1
<input type="checkbox"/>	Credit 8.1	Daylight and Views—Daylight	1
<input type="checkbox"/>	Credit 8.2	Daylight and Views—Views	1

Innovation in Design

6 Possible Points

<input type="checkbox"/>	Credit 1	Innovation in Design	1-5
<input type="checkbox"/>	Credit 2	LEED Accredited Professional	1

Regional Priority

4 Possible Points










<input type="checkbox"/>	Credit 1	Regional Priority	1-4
--------------------------	----------	-------------------	-----

LEED 2009 for New Construction and Major Renovations

100 base points; 6 possible Innovation in Design and 4 Regional Priority points

Certified	40–49 points
Silver	50–59 points
Gold	60–79 points
Platinum	80 points and above


TABLE OF CONTENTS

Preface		i
Introduction		xi
I. LEED® Green Building Rating System™		xi
II. Overview and Process		xiii
III. Minimum Program Requirements		xv
IV. Exemplary Performance Strategies		xv
Sustainable Sites (SS)		1
Prerequisite 1	Construction Activity Pollution Prevention	1
 Credit 1	Site Selection	2
Credit 2	Development Density and Community Connectivity	4
 Credit 3	Brownfield Redevelopment	5
 Credit 4.1	Alternative Transportation—Public Transportation Access	6
Credit 4.2	Alternative Transportation—Bicycle Storage and Changing Rooms	7
Credit 4.3	Alternative Transportation—Low-Emitting and Fuel-Efficient Vehicles	8
 Credit 4.4	Alternative Transportation—Parking Capacity	10
Credit 5.1	Site Development—Protect or Restore Habitat	12
Credit 5.2	Site Development—Maximize Open Space	14
 Credit 6.1	Stormwater Design—Quantity Control	15
Credit 6.2	Stormwater Design—Quality Control	16
Credit 7.1	Heat Island Effect—Nonroof	17
Credit 7.2	Heat Island Effect—Roof	19
 Credit 8	Light Pollution Reduction	21
Water Efficiency (WE)		25
Prerequisite 1	Water Use Reduction	25
 Credit 1	Water Efficient Landscaping	27
Credit 2	Innovative Wastewater Technologies	29
Credit 3	Water Use Reduction	30
Energy and Atmosphere (EA)		33
Prerequisite 1	Fundamental Commissioning of Building Energy Systems	33
 Prerequisite 2	Minimum Energy Performance	35
Prerequisite 3	Fundamental Refrigerant Management	38
 Credit 1	Optimize Energy Performance	39
Credit 2	On-site Renewable Energy	43
Credit 3	Enhanced Commissioning	44
Credit 4	Enhanced Refrigerant Management	46




 = Alternative Compliance Path for Projects Outside the U.S.

Credit 5	Measurement and Verification	48
Credit 6	Green Power	50

Materials and Resources (MR) 51

Prerequisite 1	Storage and Collection of Recyclables	51
Credit 1.1	Building Reuse—Maintain Existing Walls, Floors, and Roof	52
Credit 1.2	Building Reuse—Maintain Interior Nonstructural Elements	53
Credit 2	Construction Waste Management	54
Credit 3	Materials Reuse	55
Credit 4	Recycled Content	56
 Credit 5	Regional Materials	57
Credit 6	Rapidly Renewable Materials	59
Credit 7	Certified Wood	60

Indoor Environmental Quality (IEQ) 61

 Prerequisite 1	Minimum Indoor Air Quality Performance	61
 Prerequisite 2	Environmental Tobacco Smoke (ETS) Control	63
 Credit 1	Outdoor Air Delivery Monitoring	66
 Credit 2	Increased Ventilation	69
 Credit 3.1	Construction Indoor Air Quality Management Plan—During Construction	74
Credit 3.2	Construction Indoor Air Quality Management Plan—Before Occupancy	76
Credit 4.1	Low-Emitting Materials—Adhesives and Sealants	78
Credit 4.2	Low-Emitting Materials—Paints and Coatings	80
 Credit 4.3	Low-Emitting Materials—Flooring Systems	81
Credit 4.4	Low-Emitting Materials—Composite Wood and Agrifiber Products	84
 Credit 5	Indoor Chemical and Pollutant Source Control	85
Credit 6.1	Controllability of Systems—Lighting	87
 Credit 6.2	Controllability of Systems—Thermal Comfort	88
 Credit 7.1	Thermal Comfort—Design	90
 Credit 7.2	Thermal Comfort—Verification	91
Credit 8.1	Daylight and Views—Daylight	92
Credit 8.2	Daylight and Views—Views	95

Innovation in Design (ID) 97

Credit 1	Innovation in Design	97
Credit 2	LEED® Accredited Professional	98

Regional Priority (RP) 99

Credit 1	Regional Priority	99
----------	-------------------	----

 = Alternative Compliance Path for Projects Outside the U.S.

INTRODUCTION

I. LEED® GREEN BUILDING RATING SYSTEM

Background on LEED®

Following the formation of the U.S. Green Building Council (USGBC) in 1993, the organization's members quickly realized that the sustainable building industry needed a system to define and measure "green buildings." USGBC began to research existing green building metrics and rating systems. Less than a year after formation, the members acted on the initial findings by establishing a committee to focus solely on this topic. The composition of the committee was diverse; it included architects, real estate agents, a building owner, a lawyer, an environmentalist, and industry representatives. This cross section of people and professions added a richness and depth both to the process and to the ultimate product.

The first LEED Pilot Project Program, also referred to as LEED Version 1.0, was launched at the USGBC Membership Summit in August 1998. After extensive modifications, LEED Green Building Rating System Version 2.0 was released in March 2000, with LEED Version 2.1 following in 2002 and LEED Version 2.2 following in 2005.

As LEED has evolved and matured, the program has undertaken new initiatives. In addition to a rating system specifically devoted to building operational and maintenance issues (LEED for Existing Buildings: Operations & Maintenance), LEED addresses the different project development and delivery processes that exist in the U.S. building design and construction market, through rating systems for specific building typologies, sectors, and project scopes: LEED for Core & Shell, LEED for New Construction, LEED for Schools, LEED for Neighborhood Development, LEED for Retail, LEED for Healthcare, LEED for Homes, and LEED for Commercial Interiors.

Project teams interact with the Green Building Certification Institute (GBCI) for project registration and certification. GBCI was established in 2008 as a separately incorporated entity with the support of the U.S. Green Building Council. GBCI administers credentialing and certification programs related to green building practice. These programs support the application of proven strategies for increasing and measuring the performance of buildings and communities as defined by industry systems such as LEED.

The green building field is growing and changing daily. New technologies and products are being introduced into the marketplace, and innovative designs and practices are proving their effectiveness. The LEED rating systems and reference guides will evolve as well. Project teams must comply with the version of the rating system that is current at the time of their registration.

USGBC will highlight new developments on its website on a continual basis at www.usgbc.org.

Features of LEED®

The LEED Green Building Rating Systems are voluntary, consensus-based, and market-driven. Based on existing and proven technology, they evaluate environmental performance from a whole building perspective over a building's life cycle, providing a definitive standard for what constitutes a green building in design, construction, and operation.

The LEED rating systems are designed for rating new and existing commercial, institutional, and residential buildings. They are based on accepted energy and environmental principles and strike a balance between known, established practices and emerging concepts. Each rating system is organized into 5 environmental categories:

Sustainable Sites, Water Efficiency, Energy and Atmosphere, Materials and Resources, and Indoor Environmental Quality. An additional category, Innovation in Design, addresses sustainable building expertise as well as design measures not covered under the 5 environmental categories. Regional bonus points are another feature of LEED and acknowledge the importance of local conditions in determining best environmental design and construction practices.

The LEED Credit Weightings

In LEED 2009, the allocation of points between credits is based on the potential environmental impacts and human benefits of each credit with respect to a set of impact categories. The impacts are defined as the environmental or human effect of the design, construction, operation, and maintenance of the building, such as greenhouse gas emissions, fossil fuel use, toxins and carcinogens, air and water pollutants, indoor environmental conditions. A combination of approaches, including energy modeling, life-cycle assessment, and transportation analysis, is used to quantify each type of impact. The resulting allocation of points among credits is called credit weighting.

LEED 2009 uses the U.S. Environmental Protection Agency's TRACI¹ environmental impact categories as the basis for weighting each credit. TRACI was developed to assist with impact evaluation for life-cycle assessment, industrial ecology, process design, and pollution prevention.

LEED 2009 also takes into consideration the weightings developed by the National Institute of Standards and Technology (NIST); these compare impact categories with one another and assign a relative weight to each. Together, the 2 approaches provide a solid foundation for determining the point value of each credit in LEED 2009.

The LEED 2009 credit weightings process is based on the following parameters, which maintain consistency and usability across rating systems:

- All LEED credits are worth a minimum of 1 point.
- All LEED credits are positive, whole numbers; there are no fractions or negative values.
- All LEED credits receive a single, static weight in each rating system; there are no individualized scorecards based on project location.
- All LEED rating systems have 100 base points; Innovation in Design (or Operations) and Regional Priority credits provide opportunities for up to 10 bonus points.

Given the above criteria, the LEED 2009 credit weightings process involves 3 steps:

1. A reference building is used to estimate the environmental impacts in 13 categories associated with a typical building pursuing LEED certification.
2. The relative importance of building impacts in each category are set to reflect values based on the NIST weightings.²
3. Data that quantify building impacts on environmental and human health are used to assign points to individual credits.

Each credit is allocated points based on the relative importance of the building-related impacts that it addresses. The result is a weighted average that combines building impacts and the relative value of the impact categories. Credits that most directly address the most important impacts are given the greatest weight, subject to the system design parameters described above. Credit weights also reflect a decision by LEED to recognize the market implications of point allocation. The result is a significant change in allocation of points compared with previous LEED rating systems. Overall, the changes increase the relative emphasis on the reduction of energy consumption and greenhouse gas emissions associated with building systems, transportation, the embodied energy of water, the embodied energy of materials, and where applicable, solid waste.

The details of the weightings process vary slightly among individual rating systems. For example, LEED for Existing Buildings: Operations & Maintenance includes credits related to solid waste management but LEED for New Construction does not. This results in a difference in the portion of the environmental footprint addressed by each rating system and the relative allocation of points. The weightings process for each rating system is fully documented in a weightings workbook.

The credit weightings process will be reevaluated over time to incorporate changes in values ascribed to different building impacts and building types, based on both market reality and evolving scientific knowledge related to buildings. A complete explanation of the LEED credit weightings system is available on the USGBC website, at www.usgbc.org.

Regional Priority Credits

To provide incentive to address geographically specific environmental issues, USGBC regional councils and chapters have identified 6 credits per rating system that are of particular importance to specific areas. Each regional priority credit is worth an additional 1 point, and a total of 4 regional priority points may be earned. Upon project registration, LEED-Online automatically determines a project's regional priority credits based on its zip code. If the project achieves more than 4 regional priority credits, the team can choose the credits for which these points will apply. The USGBC website also contains a searchable database of regional priority credits.

Alternative Compliance Paths For Projects Outside the U.S. (ACPs)

As interest in the LEED rating system grew, the need to accommodate a growing number of international projects became more apparent. In an effort to make achieving LEED certification more accessible to projects worldwide, the U.S. Green Building Council (USGBC) has developed a series of Alternative Compliance Paths (ACPs) for projects outside the U.S. These ACPs have been developed with guidance from international green building experts and volunteers, and fully retain the integrity of LEED. The collective efforts of volunteers, subject matter experts, and USGBC staff resulted in the creation of ACPs for the LEED for New Construction, LEED for Core & Shell, LEED for Schools, and for the LEED for Existing Buildings: Operations & Maintenance rating systems. The ACPs – additional options – are substitute credit and prerequisite requirements that establish a new and different way to demonstrate compliance with the stated intent of a credit or prerequisite. Also, metric conversions for all current LEED measurements are now available.

The credits for which Alternative Compliance Paths for Projects outside the U.S. (ACPs) are available are noted throughout the rating system by the logo shown below.



II. OVERVIEW AND PROCESS

The LEED 2009 Green Building Rating System for New Construction and Major Renovations is a set of performance standards for certifying the design and construction of commercial or institutional buildings and high-rise residential buildings of all sizes, both public and private. The intent is to promote healthful, durable, affordable, and environmentally sound practices in building design and construction.

Prerequisites and credits in the LEED 2009 for New Construction and Major Renovations addresses 7 topics:

- Sustainable Sites (SS)
- Water Efficiency (WE)
- Energy and Atmosphere (EA)

- Materials and Resources (MR)
- Indoor Environmental Quality (IEQ)
- Innovation in Design (ID)
- Regional Priority (RP)

LEED 2009 for New Construction and Major Renovations certifications are awarded according to the following scale:

Certified	40–49 points
Silver	50–59 points
Gold	60–79 points
Platinum	80 points and above

GBCI will recognize buildings that achieve 1 of these rating levels with a formal letter of certification.

When to Use LEED 2009 for New Construction

LEED for New Construction was designed primarily for new commercial office buildings, but it has been applied to many other building types by LEED practitioners. All commercial buildings, as defined by standard building codes, are eligible for certification as LEED for New Construction buildings. Examples of commercial occupancies include offices, institutional buildings (libraries, museums, churches, etc.), hotels, and residential buildings of 4 or more habitable stories.

LEED for New Construction addresses design and construction activities for both new buildings and major renovations of existing buildings. If the project scope does not involve significant design and construction activities and focuses more on operations and maintenance activities, LEED for Existing Buildings: Operations & Maintenance is more appropriate because it addresses operational and maintenance issues of working buildings. Please see the Rating System Selection Policy, located in the LEED resources section of www.usgbc.org, for more information about choosing a rating system.

Registration

Project teams interested in earning LEED certification for their buildings must first register the project with GBCI. Projects can be registered on the GBCI website (www.gbci.org). The website also has information on registration costs for USGBC national members as well as nonmembers. Registration is an important step that establishes contact with GBCI and provides access to software tools, errata, critical communications, and other essential information.

Certification

To earn LEED certification, the applicant project must satisfy all the prerequisites and qualify for a minimum number of points to attain the established project ratings as listed below. Having satisfied the basic prerequisites of the program, applicant projects are then rated according to their degree of compliance within the rating system.

LEED 2009 for New Construction provides the option of splitting a certification application into two phases: design and construction. Documentation for design phase credits, identified in LEED-Online, can be submitted for review at the end of the design phase; the submittals for these credits can be fully evaluated based on documentation available during this phase of the project. For example, if a project site meets the requirements of LEED for New Construction SS Credit 3, Brownfield Redevelopment, the likelihood of credit achievement can be assessed before construction is complete. The LEED credit itself, however, is not awarded at the design review stage.

For more information on the LEED certification process including LEED-Online, Credit Interpretation Requests and Rulings, Appeals, and Fees please see the LEED Reference Guide for Green Building Design and Construction, 2009 Edition and visit www.usgbc.org or www.gbci.org.

III. MINIMUM PROGRAM REQUIREMENTS

The LEED 2009 Minimum Program Requirements (MPRs) define the minimum characteristics that a project must possess in order to be eligible for certification under LEED 2009. These requirements define the categories of buildings that the LEED rating systems were designed to evaluate, and taken together serve three goals: to give clear guidance to customers, to protect the integrity of the LEED program, and to reduce challenges that occur during the LEED certification process. It is expected that MPRs will evolve over time along with LEED rating system improvements. The requirements will apply only to those projects registering under LEED 2009.

To view the MPRs and the MPR Supplemental Guidance, visit the LEED Resources and Tools section of www.usgbc.org/projecttools.

IV. EXEMPLARY PERFORMANCE STRATEGIES

Exemplary performance strategies result in performance that greatly exceeds the performance level or expands the scope required by an existing LEED 2009 for New Construction credit. To earn exemplary performance credits, teams must meet the performance level defined by the next step in the threshold progression. For credits with more than 1 compliance path, an Innovation in Design point can be earned by satisfying more than 1 compliance path if their benefits are additive.

The credits for which exemplary performance points are available through expanded performance or scope are noted in the LEED Reference Guide for Green Design & Construction, 2009 Edition and in LEED-Online.

Endnotes

- ¹ Tools for the Reduction and Assessment of Chemical and Other Environmental Impacts (TRACI). U.S. Environmental Protection Agency, Office of Research and Development. <http://www.epa.gov/nrmrl/std/sab/traci/>.
- ² Relative impact category weights based on an exercise undertaken by NIST (National Institute of Standards and Technology) for the BEES program. <http://www.bfrl.nist.gov/oe/software/bees/>.

SUSTAINABLE SITES

SS Prerequisite 1: Construction Activity Pollution Prevention

Required

Intent

To reduce pollution from construction activities by controlling soil erosion, waterway sedimentation and airborne dust generation.

Requirements

Create and implement an erosion and sedimentation control plan for all construction activities associated with the project. The plan must conform to the erosion and sedimentation requirements of the 2003 EPA Construction General Permit OR local standards and codes, whichever is more stringent. The plan must describe the measures implemented to accomplish the following objectives:

- To prevent loss of soil during construction by stormwater runoff and/or wind erosion, including protecting topsoil by stockpiling for reuse.
- To prevent sedimentation of storm sewers or receiving streams.
- To prevent pollution of the air with dust and particulate matter.

The EPA's construction general permit outlines the provisions necessary to comply with Phase I and Phase II of the National Pollutant Discharge Elimination System (NPDES) program. While the permit only applies to construction sites greater than 1 acre (0.4 hectare), the requirements are applied to all projects for the purposes of this prerequisite. Information on the EPA construction general permit is available at <http://cfpub.epa.gov/npdes/stormwater/cgp.cfm>.

Potential Technologies & Strategies

Create an erosion and sedimentation control plan during the design phase of the project. Consider employing strategies such as temporary and permanent seeding, mulching, earthen dikes, silt fencing, sediment traps and sediment basins.

SS Credit 1: Site Selection

1 Point

Intent

To avoid the development of inappropriate sites and reduce the environmental impact from the location of a building on a site.

Requirements

Do not develop buildings, hardscape, roads or parking areas on portions of sites that meet any of the following criteria:

- Prime farmland as defined by the U.S. Department of Agriculture in the United States Code of Federal Regulations, Title 7, Volume 6, Parts 400 to 699, Section 657.5 (citation 7CFR657.5)
- Previously undeveloped land whose elevation is lower than 5 feet (1.5 meters) above the elevation of the 100-year flood as defined by the Federal Emergency Management Agency (FEMA)
- Land specifically identified as habitat for any species on federal or state threatened or endangered lists
- Land within 100 feet (30 meters) of any wetlands as defined by the U.S. Code of Federal Regulations 40 CFR, Parts 230-233 and Part 22, and isolated wetlands or areas of special concern identified by state or local rule, OR within setback distances from wetlands prescribed in state or local regulations, as defined by local or state rule or law, whichever is more stringent
- Previously undeveloped land that is within 50 feet (15 meters) of a water body, defined as seas, lakes, rivers, streams and tributaries that support or could support fish, recreation or industrial use, consistent with the terminology of the Clean Water Act
- Land that prior to acquisition for the project was public parkland, unless land of equal or greater value as parkland is accepted in trade by the public landowner (park authority projects are exempt).

OR



Alternative Compliance Path for Projects Outside the U.S.

Do not develop buildings, hardscape, roads or parking areas on portions of sites that meet any of the following criteria:

- High-value farmland as defined by the relevant local, regional, state, provincial or federal government agency.
- Previously undeveloped land within areas classified at high or very high hydrogeologic risk, including any land whose elevation is lower than 5 feet (1.5 meters) above the elevation of the 100-year flood.
- Land specifically identified as habitat for any species listed as threatened or endangered by the national, state, provincial, territorial or regional authority.

-
- Land within 100 feet (30 meters) of a wetland listed as being of high ecological value by the relevant local, regional, state, provincial or federal government agency. Renovation of an existing building is allowed if construction impact is limited to the existing development footprint.
 - Previously undeveloped land that is within 50 feet (15 meters) of a water body, defined as seas, lakes, rivers, streams and tributaries that supports that supports or could support aquatic life, recreation or industrial use, as determined by a professional biologist.
 - Land that prior to acquisition for the project was public parkland except for projects which are operated by and support the function of the park.

Potential Technologies & Strategies

During the site selection process, give preference to sites that do not include sensitive elements or restrictive land types. Select a suitable building location and design the building with a minimal footprint to minimize disruption of the environmentally sensitive areas identified above.

SS Credit 2: Development Density and Community Connectivity

5 Points

Intent

To channel development to urban areas with existing infrastructure, protect greenfields, and preserve habitat and natural resources.

Requirements

OPTION 1. Development Density

Construct or renovate a building on a previously developed site AND in a community with a minimum density of 60,000 square feet per acre net (13,800 square meters per hectare net). The density calculation is based on a typical two-story downtown development and must include the area of the project being built.

OR

OPTION 2. Community Connectivity

Construct or renovate a building on a site that meets the following criteria:

- Is located on a previously developed site
- Is within 1/2 mile (800 meters) of a residential area or neighborhood with an average density of 10 units per acre net (10 units per 0.4 hectare net)
- Is within 1/2 mile (800 meters) of at least 10 basic services
- Has pedestrian access between the building and the services

For mixed-use projects, no more than 1 service within the project boundary may be counted as 1 of the 10 basic services, provided it is open to the public. No more than 2 of the 10 services required may be anticipated (i.e., at least 8 must be existing and operational). In addition, the anticipated services must demonstrate that they will be operational in the locations indicated within 1 year of occupation of the applicant project.

Examples of basic services include the following:

- | | | |
|-----------------------|----------------------------|--------------------|
| ■ Bank | ■ Laundry | ■ School |
| ■ Place of Worship | ■ Library | ■ Supermarket |
| ■ Convenience Grocery | ■ Medical or Dental Office | ■ Theater |
| ■ Day Care Center | ■ Senior Care Facility | ■ Community Center |
| ■ Cleaners | ■ Park | ■ Fitness Center |
| ■ Fire Station | ■ Pharmacy | ■ Museum |
| ■ Beauty Salon | ■ Post Office | |
| ■ Hardware | ■ Restaurant | |

Proximity is determined by drawing a 1/2-mile radius (800-meter) around a main building entrance on a site map and counting the services within that radius.

Potential Technologies & Strategies

During the site selection process, give preference to urban sites with pedestrian access to a variety of services.

LEED 2009 FOR NEW CONSTRUCTION AND MAJOR RENOVATIONS RATING SYSTEM
WITH ALTERNATIVE COMPLIANCE PATHS FOR PROJECTS OUTSIDE THE U.S.

SS Credit 3: Brownfield Redevelopment

1 Point

Intent

To rehabilitate damaged sites where development is complicated by environmental contamination and to reduce pressure on undeveloped land.

Requirements

OPTION 1

Develop on a site documented as contaminated (by means of an ASTM E1903-97 Phase II Environmental Site Assessment or a local voluntary cleanup program).

OR

OPTION 2

Develop on a site defined as a brownfield by a local, state, or federal government agency.

For projects where asbestos is found and remediated also earn this credit. Testing should be done in accordance with EPA Reg 40CFR part 763, when applicable.

OR



Alternative Compliance Path for Projects Outside the U.S.

Develop on a site where the risk of contamination has been determined via relevant local, state, provincial, or federal contamination risk protocols. Where site contamination was identified, demonstrate that site remediation was completed according to the relevant local, state, provincial, or federal requirements.

Potential Technologies & Strategies

During the site selection process, give preference to brownfield sites. Identify tax incentives and property cost savings. Coordinate site development plans with remediation activity, as appropriate.

SS Credit 4.1: Alternative Transportation—Public Transportation Access

6 Points

Intent

To reduce pollution and land development impacts from automobile use.

Requirements

OPTION 1. Rail Station Proximity

Locate the project within 1/2-mile (800-meter) walking distance (measured from a main building entrance) of an existing or planned and funded commuter rail, light rail or subway station.

OR

OPTION 2. Bus Stop Proximity

Locate the project within 1/4-mile (400-meter) walking distance (measured from a main building entrance) of 1 or more stops for 2 or more public, campus, or private bus lines usable by building occupants.

OR



Alternative Compliance Path for Projects Outside the U.S.

Public Transportation Proximity

Locate the project within 1/4-mile (400-meter) walking distance (measured from a main building entrance) of 1 or more stops for at least 2 rideshare options for 4 or more passengers (and at least 2 passengers for human-powered conveyances). Rideshare options include passenger ferry terminals, vans and human-powered conveyances, such as rickshaws, that are authorized by the local transit authority and that meet the definition of public transportation.¹

Potential Technologies & Strategies

Perform a transportation survey of future building occupants to identify transportation needs. Locate the building near mass transit.

¹ Public transportation consists of bus, rail, or other transit services for the general public that operate on a regular, continual basis.

SS Credit 4.2: Alternative Transportation—Bicycle Storage and Changing Rooms

1 Point

Intent

To reduce pollution and land development impacts from automobile use.

Requirements

CASE 1. Commercial or Institutional Projects

Provide secure bicycle racks and/or storage within 200 yards (200 meters) of a building entrance for 5% or more of all building users (measured at peak periods)

Provide shower and changing facilities in the building, or within 200 yards (200 meters) of a building entrance, for 0.5% of full-time equivalent (FTE) occupants.

CASE 2. Residential Projects

Provide covered storage facilities for securing bicycles for 15% or more of building occupants.

Potential Technologies & Strategies

Design the building with transportation amenities such as bicycle racks and shower/changing facilities.

SS Credit 4.3: Alternative Transportation—Low-Emitting and Fuel-Efficient Vehicles

3 Points

Intent

To reduce pollution and land development impacts from automobile use.

Requirements

OPTION 1

Provide preferred parking¹ for low-emitting and fuel-efficient vehicles² for 5% of the total vehicle parking capacity of the site.

OR

OPTION 2

Install alternative-fuel fueling stations for 3% of the total vehicle parking capacity of the site. Liquid or gaseous fueling facilities must be separately ventilated or located outdoors.

OR

OPTION 3

Provide low-emitting and fuel-efficient vehicles² for 3% of full-time equivalent (FTE) occupants.

Provide preferred parking¹ for these vehicles.

OR

OPTION 4

Provide building occupants access to a low-emitting or fuel-efficient vehicle-sharing program. The following requirements must be met:

- One low-emitting or fuel-efficient vehicle must be provided per 3% of FTE occupants, assuming that 1 shared vehicle can carry 8 persons (i.e., 1 vehicle per 267 FTE occupants). For buildings with fewer than 267 FTE occupants, at least 1 low emitting or fuel-efficient vehicle must be provided.
- A vehicle-sharing contract must be provided that has an agreement of at least 2 years.
- The estimated number of customers served per vehicle must be supported by documentation.
- A narrative explaining the vehicle-sharing program and its administration must be submitted.

1 For the purposes of this credit “preferred parking” refers to the parking spots that are closest to the main entrance of the project (exclusive of spaces designated for handicapped persons) or parking passes provided at a discounted price. To establish a meaningful incentive in all potential markets, the parking rate must be discounted at least 20%. The discounted rate must be available to all eligible customers (i.e. not limited to the number of customers equal to 5% of the vehicle parking capacity), publicly posted at the entrance of the parking area, and available for a minimum of 2 years.

2 For the purposes of this credit, low-emitting vehicles are defined as vehicles that are classified as Zero Emission Vehicles (ZEV) by the California Air Resources Board. Fuel-efficient vehicles are defined as vehicles that have achieved a minimum green score of 40 on the American Council for an Energy Efficient Economy (ACEEE) annual vehicle rating guide.

-
- Parking for low-emitting and fuel-efficient vehicles must be located in the nearest available spaces in the nearest available parking area. Provide a site plan or area map clearly highlighting the walking path from the parking area to the project site and noting the distance.

Potential Technologies & Strategies

Provide transportation amenities such as alternative-fuel refueling stations. Consider sharing the costs and benefits of refueling stations with neighbors.

SS Credit 4.4: Alternative Transportation—Parking Capacity

2 Points

Intent

To reduce pollution and land development impacts from automobile use.

Requirements

CASE 1. Non-Residential Projects

OPTION 1

Size parking capacity to meet but not exceed minimum local zoning requirements.

Provide preferred parking¹ for carpools or vanpools for 5% of the total parking spaces.

OR

OPTION 2

For projects that provide parking for less than 5% of full-time equivalent (FTE) building occupants:

Provide preferred parking¹ for carpools or vanpools, marked as such, for 5% of total parking spaces.

OR

OPTION 3

Provide no new parking.

OR

OPTION 4

For projects that have no minimum local zoning requirements, provide 25% fewer parking spaces than the applicable standard listed in the 2003 Institute of Transportation Engineers (ITE) “Parking Generation” study at <http://www.ite.org>.

¹ For the purposes of this credit “preferred parking” refers to the parking spots that are closest to the main entrance of the project (exclusive of spaces designated for handicapped persons) or parking passes provided at a discounted price. To establish a meaningful incentive in all potential markets, the parking rate must be discounted at least 20%. The discounted rate must be available to all eligible customers (i.e. not limited to the number of customers equal to 5% of the vehicle parking capacity), publicly posted at the entrance of the parking area, and available for a minimum of 2 years.

CASE 2. Residential Projects

OPTION 1

Size parking capacity to meet but not exceed minimum local zoning requirements.

Provide infrastructure and support programs to facilitate shared vehicle use such as carpool drop-off areas, designated parking for vanpools, car-share services, ride boards and shuttle services to mass transit.

OR

OPTION 2

Provide no new parking.

CASE 3. Mixed Use (Residential with Commercial/Retail) Projects

OPTION 1

Mixed-use buildings with less than 10% commercial area must be considered residential and adhere to the residential requirements in Case 2. For mixed-use buildings with more than 10% commercial area, the commercial space must adhere to non-residential requirements in Case 1 and the residential component must adhere to residential requirements in Case 2.

OR

OPTION 2

Provide no new parking.

OR



Alternative Compliance Path for Projects Outside the U.S.

CASE 1. Non-Residential Projects

For projects that have no minimum parking requirements, do not exceed 3.5 spaces per 1,000 square feet (95 square meters) of gross floor area or 1 parking space for every full-time equivalent (FTE),³ whichever is less.

Provide preferred parking¹ for carpools or vanpools for 5% of the total parking spaces.

Potential Technologies & Strategies

Minimize parking lot/garage size. Consider sharing parking facilities with adjacent buildings. Consider alternatives that will limit the use of single occupancy vehicles.

³ If FTE is unknown, use occupancy counts from LEED-CS Appendix 1 in the LEED Reference Guide for Green Building Design and Construction.

SS Credit 5.1: Site Development—Protect or Restore Habitat

1 Point

Intent

To conserve existing natural areas and restore damaged areas to provide habitat and promote biodiversity.

Requirements

CASE 1. Greenfield Sites¹

Limit all site disturbance to the following parameters:

- 40 feet (12 meters) beyond the building perimeter and parking garages;
- 10 feet (3 meters) beyond surface walkways, patios, surface parking and utilities less than 12 inches (30 centimeters) in diameter;
- 15 feet (4.5 meters) beyond primary roadway curbs and main utility branch trenches;
- 25 feet (8 meters) beyond constructed areas with permeable surfaces (such as pervious paving areas, stormwater detention facilities and playing fields) that require additional staging areas to limit compaction in the constructed area.

CASE 2. Previously Developed² Areas or Graded Sites

Restore or protect a minimum of 50% of the site (excluding the building footprint) or 20% of the total site area (including building footprint), whichever is greater, with native or adapted vegetation³. Projects earning SS Credit 2: Development Density and Community Connectivity may include vegetated roof surface in this calculation if the plants are native or adapted, provide habitat, and promote biodiversity.

This OPTION is not available to Projects outside the U.S.

Projects with limited landscape opportunities may also donate offsite land in perpetuity, equal to 60% of the previously developed area (including the building footprint), to a land trust within the same EPA Level III Ecoregion identified for the project site. The land trust must adhere to the Land Trust Alliance 'Land Trust Standards and Practices' 2004 Revision.

Potential Technologies & Strategies

Survey greenfield sites to identify site elements and adopt a master plan for developing the project site. Carefully site the building to minimize disruption to existing ecosystems and design the building to minimize its footprint. Strategies include stacking the building program, tuck-under parking and sharing parking facilities with neighbors.

- 1 Greenfield sites are those that are not previously developed or graded and remain in a natural state. For projects outside the U.S. only: For the compliance path described by Case 1, rural landscapes are considered the same as greenfield sites. A *rural landscape* is a natural area modified by agro-forestry-pastoral activities, with environmental, aesthetic, cultural and historical values resulting from the interrelationship between its physical and biological aspects and traditional human activities.
- 2 Previously developed areas are those that previously contained buildings, roadways, parking lots or were graded or altered by direct human activities.
- 3 Native or adapted plants are plants indigenous to a locality or cultivars of native plants that are adapted to the local climate and are not considered invasive species or noxious weeds.

Establish clearly-marked construction boundaries to minimize disturbance of the existing site and restore previously degraded areas to their natural state. For previously developed sites, use local and regional governmental agencies, consultants, educational facilities and native plant societies as resources for the selection of appropriate native or adapted plants. Prohibit plants listed as invasive or noxious weed species. Once established, native/adapted plants require minimal or no irrigation; do not require active maintenance such as mowing or chemical inputs such as fertilizers, pesticides or herbicides; and provide habitat value and promote biodiversity through avoidance of monoculture plantings.

SS Credit 5.2: Site Development—Maximize Open Space

1 Point

Intent

To promote biodiversity by providing a high ratio of open space to development footprint.

Requirements

CASE 1. Sites with Local Zoning Open Space Requirements

Reduce the development footprint¹ and/or provide vegetated open space within the project boundary such that the amount of open space exceeds local zoning requirements by 25%.

CASE 2. Sites with No Local Zoning Requirements (e.g. some university campuses, military bases)

Provide a vegetated open space area adjacent to the building that is equal in area to the building footprint.

CASE 3. Sites with Zoning Ordinances but No Open Space Requirements

Provide vegetated open space equal to 20% of the project site area.

ALL CASES

For projects in urban areas that earn SS Credit 2: Development Density and Community Connectivity, vegetated roof areas can contribute to credit compliance.

For projects in urban areas that earn SS Credit 2: Development Density and Community Connectivity, pedestrian-oriented hardscape areas can contribute to credit compliance. For such projects, a minimum of 25% of the open space counted must be vegetated.

Wetlands or naturally designed ponds may count as open space and the side slope gradients average 1:4 (vertical: horizontal) or less and are vegetated.

Potential Technologies & Strategies

Perform a site survey to identify site elements and adopt a master plan for developing the project site. Select a suitable building location and design the building footprint to minimize site disruption. Strategies include stacking the building program, tuck-under parking and sharing parking facilities with neighbors to maximize the amount of open space on the site.

¹ Development footprint is defined as the total area of the building footprint, hardscape, access roads and parking.

SS Credit 6.1: Stormwater Design—Quantity Control

1 Point

Intent

To limit disruption of natural hydrology by reducing impervious cover, increasing on-site infiltration, reducing or eliminating pollution from stormwater runoff and eliminating contaminants.

Requirements

CASE 1. Sites with Existing Imperviousness 50% or Less

OPTION 1

Implement a stormwater management plan that prevents the postdevelopment peak discharge rate and quantity from exceeding the predevelopment peak discharge rate and quantity for the 1- and 2-year 24-hour design storms.

OR

OPTION 2

Implement a stormwater management plan that protects receiving stream channels from excessive erosion. The stormwater management plan must include stream channel protection and quantity control strategies.

CASE 2. Sites with Existing Imperviousness Greater Than 50%

Implement a stormwater management plan that results in a 25% decrease in the volume of stormwater runoff from the 2-year 24-hour design storm.

OR

Alternative Compliance Path for Projects Outside the U.S.

Manage onsite¹ runoff from the developed site for the 95th percentile of regional or local rainfall events using Low Impact Development (LID)² and green infrastructure³ strategies.

Use daily rainfall methodology in the United States Environmental Protection Agency's Technical Guidance on Implementing the Stormwater Runoff Requirements for Federal Projects under Section 438 of the Energy Independence and Security Act to determine the 95th percentile amount.

Potential Technologies & Strategies

Design the project site to maintain natural stormwater flows by promoting infiltration. Specify vegetated roofs, pervious paving and other measures to minimize impervious surfaces. Reuse stormwater for non-potable uses such as landscape irrigation, toilet and urinal flushing, and custodial uses.

¹ "Manage Onsite" refers to capturing and retaining the specified volume of rainfall to mimic natural hydrologic runoff characteristics. This includes, but is not limited to, strategies that manage volume through evapotranspiration, infiltration, or capture and reuse.

² Low Impact Development (LID) is defined as an approach to managing stormwater runoff that emphasizes on-site natural features to protect water quality by replicating the pre-development hydrologic regime of watersheds and addressing runoff close to its source. Examples include better site design principles such as minimizing land disturbance, preserving vegetation, minimizing impervious cover, and design practices like rain gardens, vegetated swales and buffers, permeable pavement, and soil amendments. These are engineered practices that may require specialized design assistance.

³ Green infrastructure is a soil and vegetation-based approach to wet weather management that is cost-effective, sustainable, and environmentally friendly (US EPA).



SS Credit 6.2: Stormwater Design—Quality Control

1 Point

Intent

To limit disruption and pollution of natural water flows by managing stormwater runoff.

Requirements

Implement a stormwater management plan that reduces impervious cover, promotes infiltration and captures and treats the stormwater runoff from 90% of the average annual rainfall¹ using acceptable best management practices (BMPs).

BMPs used to treat runoff must be capable of removing 80% of the average annual postdevelopment total suspended solids (TSS) load based on existing monitoring reports. BMPs are considered to meet these criteria if:

- They are designed in accordance with standards and specifications from a state or local program that has adopted these performance standards,

OR

- There exists infield performance monitoring data demonstrating compliance with the criteria. Data must conform to accepted protocol (e.g., Technology Acceptance Reciprocity Partnership [TARP], Washington State Department of Ecology) for BMP monitoring.

Potential Technologies & Strategies

Use alternative surfaces (e.g., vegetated roofs, pervious pavement, grid pavers) and nonstructural techniques (e.g., rain gardens, vegetated swales, disconnection of imperviousness, rainwater recycling) to reduce imperviousness and promote infiltration and thereby reduce pollutant loadings.

Use sustainable design strategies (e.g., low-impact development, environmentally sensitive design) to create integrated natural and mechanical treatment systems such as constructed wetlands, vegetated filters and open channels to treat stormwater runoff.

¹ There are 3 distinct climates in the United States that influence the nature and amount of annual rainfall. Humid watersheds are defined as those that receive at least 40 inches (102 centimeters) of rainfall each year. Semiarid watersheds receive between 20 and 40 inches (51 and 102 centimeters) of rainfall per year, and arid watersheds receive less than 20 inches (51 centimeters) of rainfall per year. For this credit, 90% of the average annual rainfall is equivalent to treating the runoff from the following (based on climate):

- Humid Watersheds — 1 inch (2.5 centimeters) of rainfall
- Semiarid Watersheds — 0.75 inches (1.9 centimeters) of rainfall
- Arid Watersheds — 0.5 inches (1.3 centimeters) of rainfall

SS Credit 7.1: Heat Island Effect—Nonroof

1 Point

Intent

To reduce heat islands¹ to minimize impacts on microclimates and human and wildlife habitats.

Requirements

Note for Projects Outside the U.S.

For each option below, if SRI information is not available for the specified product, demonstrate compliance using the SRI calculator in California's Energy Efficiency Standards for Residential and Nonresidential Buildings (California Code of Regulations, Title 24, Part 6; available at http://www.energy.ca.gov/title24/2008standards/sri_calculator/SRI_Calculator_Worksheet.pdf). This calculator uses solar reflectance and thermal emittance to determine the SRI of roofing materials.

OPTION 1

Use any combination of the following strategies for 50% of the site hardscape (including roads, sidewalks, courtyards and parking lots):

- Provide shade from the existing tree canopy or within 5 years of landscape installation. Landscaping (trees) must be in place at the time of occupancy.
- Provide shade from structures covered by solar panels that produce energy used to offset some nonrenewable resource use.
- Provide shade from architectural devices or structures that have a solar reflectance index² (SRI) of at least 29.
- Use hardscape materials with an SRI of at least 29.
- Use an open-grid pavement system (at least 50% pervious).

OR

OPTION 2

Place a minimum of 50% of parking spaces under cover³. Any roof used to shade or cover parking must have an SRI of at least 29, be a vegetated green roof or be covered by solar panels that produce energy used to offset some nonrenewable resource use.

¹ Heat islands are defined as thermal gradient differences between developed and undeveloped areas.

² The solar reflectance index (SRI) is a measure of the constructed surface's ability to reflect solar heat, as shown by a small temperature rise. It is defined so that a standard black surface (reflectance 0.05, emittance 0.90) is 0 and a standard white surface (reflectance 0.80, emittance 0.90) is 100. To calculate the SRI for a given material, obtain the reflectance value and emittance value for the material. SRI is calculated according to ASTM E 1980. Reflectance is measured according to ASTM E 903, ASTM E 1918, or ASTM C 1549. Emittance is measured according to ASTM E 408 or ASTM C 1371.

³ For the purposes of this credit, under cover parking is defined as parking underground, under deck, under roof, or under a building.

Potential Technologies & Strategies

Employ strategies, materials and landscaping techniques that reduce the heat absorption of exterior materials. Use shade (calculated on June 21, noon solar time) from native or adapted trees and large shrubs, vegetated trellises or other exterior structures supporting vegetation. Consider using new coatings and integral colorants for asphalt to achieve light-colored surfaces instead of blacktop. Position photovoltaic cells to shade impervious surfaces.

Consider replacing constructed surfaces (e.g., roof, roads, sidewalks, etc.) with vegetated surfaces such as vegetated roofs and open grid paving or specify high-albedo materials, such as concrete, to reduce heat absorption.

SS Credit 7.2: Heat Island Effect—Roof

1 Point

Intent

To reduce heat islands¹ to minimize impacts on microclimates and human and wildlife habitats.

Requirements

Note for Projects Outside the U.S.

For each option below, if SRI information is not available for the specified product, demonstrate compliance using the SRI calculator in California’s Energy Efficiency Standards for Residential and Nonresidential Buildings (California Code of Regulations, Title 24, Part 6; available at http://www.energy.ca.gov/title24/2008standards/sri_calculator/SRI_Calculator_Worksheet.pdf). This calculator uses solar reflectance and thermal emittance to determine the SRI of roofing materials.

OPTION 1

Use roofing materials with a solar reflectance index² (SRI) equal to or greater than the values in the table below for a minimum of 75% of the roof surface.

Roofing materials having a lower SRI value than those listed below may be used if the weighted rooftop SRI average meets the following criteria:

$$\frac{\text{Area Roof Meeting Minimum SRI}}{\text{Total Roof Area}} \times \frac{\text{SRI of Installed Roof}}{\text{Required SRI}} \geq 75\%$$

Alternatively, the following equation may be used to calculate compliance:

$$\frac{\left[\frac{\text{Area of Roof A}}{\text{Required SRI}} \times \text{SRI of Roof A} \right] + \left[\frac{\text{Area of Roof B}}{\text{Required SRI}} \times \text{SRI of Roof B} \right] + \dots}{0.75} \geq \text{Total Roof Area}$$

Roof Type	Slope	SRI
Low-sloped roof	≤ 2:12 (15%)	78
Steep-sloped roof	> 2:12 (15%)	29

¹ Heat islands are defined as thermal gradient differences between developed and undeveloped areas.

² The solar reflectance index (SRI) is a measure of the constructed surface’s ability to reflect solar heat, as shown by a small temperature rise. It is defined so that a standard black surface (reflectance 0.05, emittance 0.90) is 0 and a standard white surface (reflectance 0.80, emittance 0.90) is 100. To calculate the SRI for a given material, obtain the reflectance value and emittance value for the material. SRI is calculated according to ASTM E 1980. Reflectance is measured according to ASTM E 903, ASTM E 1918 or ASTM C 1549. Emittance is measured according to ASTM E 408 or ASTM C 1371.

OR

OPTION 2

Install a vegetated roof that covers at least 50% of the roof area.

OR

OPTION 3

Install high-albedo and vegetated roof surfaces that, in combination, meet the following criteria:

$$\frac{\text{Area Roof Meeting Minimum SRI}}{0.75} + \frac{\text{Area of Vegetated Roof}}{0.5} \geq \text{Total Roof Area}$$

Alternatively, a weighted average approach may be used to calculate compliance for multiple materials:

$$\left[\frac{\text{Area of Roof A} \times \frac{\text{SRI of Roof A}}{\text{Required SRI}}}{0.75} \right] + \left[\frac{\text{Area of Roof B} \times \frac{\text{SRI of Roof B}}{\text{Required SRI}}}{0.75} \right] + \frac{\text{Area of Vegetated Roof}}{0.5} \geq \text{Total Roof Area}$$

Roof Type	Slope	SRI
Low-sloped roof	≤ 2:12 (15%)	78
Steep-sloped roof	> 2:12 (15%)	29

Potential Technologies & Strategies

Consider installing high-albedo and vegetated roofs to reduce heat absorption. Default values will be available in the LEED Reference Guide for Green Building Design and Construction, 2009 Edition. Product information is available from the Cool Roof Rating Council Web site at <http://www.coolroofs.org/> and the ENERGY STAR® Web site at <http://www.energystar.gov/>.

SS Credit 8: Light Pollution Reduction

1 Point

Intent

To minimize light trespass from the building and site, reduce sky-glow to increase night sky access, improve nighttime visibility through glare reduction and reduce development impact from lighting on nocturnal environments.

Requirements

Project teams must comply with 1 of the 2 options for interior lighting AND the requirement for exterior lighting.

For Interior Lighting

OPTION 1

Reduce the input power (by automatic device) of all nonemergency interior luminaires with a direct line of sight to any openings in the envelope (translucent or transparent) by at least 50% between 11 p.m. and 5 a.m. After-hours override may be provided by a manual or occupant-sensing device provided the override lasts no more than 30 minutes.

OR

OPTION 2

All openings in the envelope (translucent or transparent) with a direct line of sight to any nonemergency luminaires must have shielding (controlled/closed by automatic device for a resultant transmittance of less than 10% between 11 p.m. and 5 a.m.).

For Exterior Lighting

Light areas only as required for safety and comfort. Exterior lighting power densities shall not exceed those specified in ANSI/ASHRAE/IESNA Standard 90.1-2007 with Addenda 1 for the documented lighting zone. Justification shall be provided for the selected lighting zone. Lighting controls for all exterior lighting shall comply with section 9.4.1.3 of ANSI/ASHRAE/IESNA Standard 90.1-2007, without amendments¹.

Classify the project under 1 of the following zones, as defined in IESNA RP-33, and follow all the requirements for that zone:

LZ1: Dark (developed areas within national parks, state parks, forest land and rural areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.01 horizontal and vertical footcandles (0.1 horizontal and vertical lux) at the LEED project boundary and beyond. Document that 0% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

¹ The requirement to use ASHRAE Addenda I is unique to this credit and does not obligate Project teams to use ASHRAE approved addenda for other credits.

LZ2: Low (primarily residential zones, neighborhood business districts, light industrial areas with limited nighttime use and residential mixed-use areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.10 horizontal and vertical footcandles (1.0 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 10 feet (3 meters) beyond the LEED project boundary. Document that no more than 2% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ3: Medium (all other areas not included in LZ1, LZ2 or LZ4, such as commercial/ industrial, and high-density residential)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.20 horizontal and vertical footcandles (2.0 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 15 feet (4.5 meters) beyond the site. Document that no more than 5% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ4: High² (high-activity commercial districts in major metropolitan areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.60 horizontal and vertical footcandles (6.5 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 15 feet (4.5 meters) beyond the site. Document that no more than 10% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ2, LZ3 and LZ4 - For LEED project boundaries that abut public rights-of-way, light trespass requirements may be met relative to the curb line instead of the LEED project boundary.

For All Zones

Illuminance generated from a single luminaire placed at the intersection of a private vehicular driveway and public roadway accessing the site is allowed to use the centerline of the public roadway as the LEED project boundary for a length of 2 times the driveway width centered at the centerline of the driveway.

OR



Alternative Compliance Path for Projects Outside the U.S.

Comply with 1 of the 2 options for interior lighting AND the requirement for exterior lighting.

For Interior Lighting

OPTION 1

Reduce the input power (by automatic device) of all nonemergency interior luminaires with a direct line of sight to any openings in the envelope (translucent or transparent) by at least 50% between 11 p.m. and 5 a.m. After-hours override may be provided by a manual or occupant-sensing device, provided the override lasts no more than 30 minutes.

² To be LZ4, the area must be so designated by an organization with local jurisdiction, such as the local zoning authority.

OR

OPTION 2

All openings in the envelope (translucent or transparent) with a direct line of sight to any nonemergency luminaires must have shielding (controlled/closed by automatic device for a resultant transmittance of less than 10% between 11 p.m. and 5 a.m.).

For Exterior Lighting

Light areas only as required for safety and comfort. Exterior lighting power densities shall not exceed those specified below for the documented lighting zone. Justification shall be provided for the selected lighting zone. Lighting controls for all exterior lighting shall comply with the prescribed requirements stated in the table below (based on ANSI/ASHRAE/IESNA Standard 90.1 2007).¹

<p>Tradable surfaces</p> <p>(LPDs for uncovered parking areas, building grounds, building entrances and exits, canopies and overhangs, and outdoor sales areas may be traded.)</p>	<p>Uncovered parking areas</p> <p>Parking lots and drives</p>	0.15 W/ft ² (1.6 W/m ²)
	<p>Building grounds</p> <p>Walkways less than 10 feet (3 meters) wide</p>	1.0 W/linear foot (3.3 W/linear meter)
	<p>Walkways 10 feet (3 meters) wide or greater</p> <p>Plaza areas</p> <p>Special feature areas</p>	0.2 W/ft ² (2.2 W/m ²)
	<p>Stairways</p>	1.0 W/ft ² (10.8 W/m ²)
	<p>Building entrances and exits</p> <p>Main entries</p>	30 W/linear foot of door width (99 W/linear meter)
	<p>Other doors</p>	20 W/linear foot of door width (66 W/linear meter)
	<p>Canopies and overhangs</p> <p>Canopies (free-standing and attached and overhangs)</p>	1.25 W/ft ² (13.5 W/m ²)
	<p>Outdoor sales</p> <p>Open areas (including vehicle sales lots)</p>	0.5 W/ft ² (5.4 W/m ²)
	<p>Street frontage for vehicle sales lots in addition to "open area" allowance</p>	20 W/linear foot (66 W/linear meter)
	<p>Nontradable surfaces</p> <p>(LPD calculations for the following applications can be used only for the specific application and cannot be traded between surfaces or with other exterior lighting. The following allowances are in addition to any allowances for tradable surfaces.)</p>	<p>Building façades</p>
<p>Automated teller machines and night depositories</p>		270 W per location plus 90 W per additional ATM per location
<p>Entrances and gatehouse inspection stations at guarded facilities</p>		1.25 W/ft ² (13.5 W/m ²) of uncovered area (covered areas are included in the "Canopies and Overhangs" section of "Tradable Surfaces")
<p>Loading areas for law enforcement, fire, ambulance and other emergency service vehicles</p>		0.5 W/ft ² (5.4 W/m ²) of uncovered area (covered areas are included in the "Canopies and Overhangs" section of "Tradable Surfaces")
<p>Drive-through windows at quick-service restaurants</p>		400 W per drive-through
<p>Parking near 24-hour retail entrances</p>		800 W per main entry

Classify the project under 1 of the following zones and follow all the requirements for that zone:

LZ1: Dark (developed areas within national parks, state or provincial parks, forestland and rural areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.01 horizontal and vertical footcandles (0.1 horizontal and vertical lux) at the LEED project boundary and beyond. Document that 0% of the total initial designed fixture luminance (sum total of all fixtures on site) is emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ2: Low (primarily residential zones, neighborhood business districts, light industrial areas with limited nighttime use and residential mixed-use areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.10 horizontal and vertical footcandles (1.0 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 10 feet (3 meters) beyond the LEED project boundary. Document that no more than 2% of the total initial designed fixture luminance (sum total of all fixtures on site) is emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ3: Medium (all other areas not included in LZ1, LZ2 or LZ4, such as commercial, industrial and high-density residential)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.20 horizontal and vertical footcandles (2.0 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 15 feet (4.5 meters) beyond the site. Document that no more than 5% of the total initial designed fixture luminance (sum total of all fixtures on site) is emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ4: High³ (high-activity commercial districts in major metropolitan areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.60 horizontal and vertical footcandles (6.5 horizontal and vertical lux) at the LEED project boundary and no greater than 0.01 horizontal footcandles (0.1 horizontal lux) 15 feet (4.5 meters) beyond the site. Document that no more than 10% of the total initial designed fixture luminance (sum total of all fixtures on site) is emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ2, LZ3 and LZ4

For LEED project boundaries that abut public rights-of-way, light trespass requirements may be met relative to the curb line instead of the LEED project boundary.

For All Zones

For illuminance generated from a single luminaire placed at the intersection of a private vehicular driveway and public roadway accessing the site, the centerline of the public roadway may be used as the LEED project boundary for a length of 2 times the driveway width centered at the centerline of the driveway.

Potential Technologies & Strategies

Adopt site lighting criteria to maintain safe light levels while avoiding off-site lighting and night sky pollution. Minimize site lighting where possible, and use computer software to model the site lighting. Technologies to reduce light pollution include full cutoff luminaires, low-reflectance surfaces and low-angle spotlights.

³ To be LZ4, the area must be so designated by an organization with local jurisdiction, such as the local zoning authority.

WATER EFFICIENCY

WE Prerequisite 1: Water Use Reduction

Required

Intent

To increase water efficiency within buildings to reduce the burden on municipal water supply and wastewater systems.

Requirements

Employ strategies that in aggregate use 20% less water than the water use baseline calculated for the building (not including irrigation).

Calculate the baseline according to the commercial and/or residential baselines outlined below.¹ Calculations are based on estimated occupant usage and must include only the following fixtures and fixture fittings (as applicable to the project scope): water closets, urinals, lavatory faucets, showers, kitchen sink faucets and prerinse spray valves.

Commercial Fixtures, Fittings, and Appliances	Current Baseline (Imperial Units)	Current Baseline (Metric units)
Commercial toilets	1.6 gallons per flush (gpf)* Except blow-out fixtures: 3.5 (gpf)	6 liters per flush (lpf) Except blow-out fixtures: 13 lpf
Commercial urinals	1.0 (gpf)	4 lpf
Commercial lavatory (restroom) faucets	2.2 gallons per minute (gpm) at 60 pounds per square inch (psi), private applications only (hotel or motel guest rooms, hospital patient rooms) 0.5 (gpm) at 60 (psi)** all others except private applications 0.25 gallons per cycle for metering faucets	8.5 liters per minute (lpm) at 4 bar (58 psi), private applications only (hotel or motel guest rooms, hospital patient rooms) 2.0 lpm at 4 bar (58 psi), all others except private applications 1 liter per cycle for metering faucets
Showerheads	2.5 (gpm) at 80 (psi) per shower stall ****	9.5 lpm at 5 bar (58 psi)
For projects with commercial pre-rinse spray valves, the flow rate must comply with the ASME A112.18.1 standard of 1.6 gpm or less.		

Residential Fixtures, Fittings, and Appliances	Current Baseline (Imperial units)	Current Baseline (Metric units)
Residential toilets	1.6 (gpf)***	6 liters per flush (lpf) Except blow-out fixtures: 13 lpf
Residential lavatory (bathroom) faucets	2.2 (gpm) at 60 psi	4 lpm 8.5 lpm at 4 bar (58 psi), private applications only (hotel or motel guest rooms, hospital patient rooms)
Residential kitchen faucet		2.0 lpm at 4 bar (58 psi), all others except private applications 1 liter per cycle for metering faucets
Residential showerheads	2.5 (gpm) at 80 (psi) per shower stall****	Flow rate ≤ 6.1 lpm (no pressure specified; no performance requirement)

* EPAAct 1992 standard for toilets applies to both commercial and residential models.

** In addition to EPAAct requirements, the American Society of Mechanical Engineers standard for public lavatory faucets is 0.5 gpm at 60 psi (2.0 lpm at 4 bar (58 psi)) (ASME A112.18.1-2005). This maximum has been incorporated into the national Uniform Plumbing Code and the International Plumbing Code.

*** EPAAct 1992 standard for toilets applies to both commercial and residential models.

**** Residential shower compartment (stall) in dwelling units: The total allowable flow rate from all flowing showerheads at any given time, including rain systems, waterfalls, bodysprays, bodyspas and jets, must be limited to the allowable showerhead flow rate as specified above (2.5 gpm) per shower compartment, where the floor area of the shower compartment is less than 2,500 square inches (1.5 square meters). For each increment of 2,500 square inches (1.5 square meters) of floor area thereafter or part thereof, an additional showerhead with total allowable flow rate from all flowing devices equal to or less than the allowable flow rate as specified above must be allowed. Exception: Showers that emit recirculated nonpotable water originating from within the shower compartment while operating are allowed to exceed the maximum as long as the total potable water flow does not exceed the flow rate as specified above.

¹ Tables adapted from information developed and summarized by the U.S. Environmental Protection Agency (EPA) Office of Water based on requirements of the Energy Policy Act (EPAAct) of 1992 and subsequent rulings by the Department of Energy, requirements of the EPAAct of 2005, and the plumbing code requirements as stated in the 2006 editions of the Uniform Plumbing Code or International Plumbing Code pertaining to fixture performance.

The following fixtures, fittings and appliances are outside the scope of the water use reduction calculation:

- Commercial Steam Cookers
- Commercial Dishwashers
- Automatic Commercial Ice Makers
- Commercial (family sized) Clothes Washers
- Residential Clothes Washers
- Standard and Compact Residential Dishwashers

Potential Technologies & Strategies

WaterSense-certified fixtures and fixture fittings should be used where available. Use high-efficiency fixtures (e.g., water closets and urinals) and dry fixtures, such as toilets attached to composting systems, to reduce potable water demand. Consider using alternative on-site sources of water (e.g., rainwater, stormwater, and air conditioner condensate) and graywater for nonpotable applications such as custodial uses and toilet and urinal flushing. The quality of any alternative source of water used must be taken into consideration based on its application or use.

WE Credit 1: Water Efficient Landscaping

2–4 Points

Intent

To limit or eliminate the use of potable water or other natural surface or subsurface water resources available on or near the project site for landscape irrigation.

Requirements

OPTION 1. Reduce by 50% (2 points)

Reduce potable water consumption for irrigation by 50% from a calculated midsummer baseline case.

Reductions must be attributed to any combination of the following items:

- Plant species, density and microclimate factor
- Irrigation efficiency
- Use of captured rainwater
- Use of recycled wastewater
- Use of water treated and conveyed by a public agency specifically for nonpotable uses

Groundwater seepage that is pumped away from the immediate vicinity of building slabs and foundations may be used for landscape irrigation to meet the intent of this credit. However, the project team must demonstrate that doing so does not affect site stormwater management systems.

OR

OPTION 2. No Potable Water Use or Irrigation¹ (4 points)

Meet the requirements for Option 1.

AND

PATH 1

Use only captured rainwater, recycled wastewater, recycled graywater or water treated and conveyed by a public agency specifically for nonpotable uses for irrigation.

OR

PATH 2

Install landscaping that does not require permanent irrigation systems. Temporary irrigation systems used for plant establishment are allowed only if removed within a period not to exceed 18 months of installation.

¹ If the percent reduction of potable water is 100% AND the percent reduction of total water is equal to or greater than 50%, then Option 2 is earned, for a total of 4 points.



OR

Alternative Compliance Path for Projects Outside the U.S.

OPTION 1. Reduce by 50% (2 points)

Reduce potable water consumption for irrigation by 50% from a calculated baseline case for the month with the highest evapotranspiration rate.

Reductions must be attributed to any combination of the following items:

- Plant species, density and microclimate factor
- Irrigation efficiency
- Use of captured rainwater
- Use of recycled wastewater
- Use of water treated and conveyed by a public agency specifically for nonpotable uses

OR

OPTION 2. No Potable Water Use or Irrigation¹ (4 points)

Meet the requirements for Option 1.

AND

PATH 1

Use only captured rainwater, recycled wastewater, recycled graywater or water treated and conveyed by a public agency specifically for nonpotable uses for irrigation.

OR

PATH 2

Install landscaping that does not require permanent irrigation systems. Temporary irrigation systems used for plant establishment are allowed only if removed within a period not to exceed 18 months of installation.

Potential Technologies & Strategies

Perform a soil/climate analysis to determine appropriate plant material and design the landscape with native or adapted plants to reduce or eliminate irrigation requirements. Where irrigation is required, use high-efficiency equipment and/or climate-based controllers.

WE Credit 2: Innovative Wastewater Technologies

2 Points

Intent

To reduce wastewater generation and potable water demand while increasing the local aquifer recharge.

Requirements

OPTION 1

Reduce potable water use for building sewage conveyance by 50% through the use of water-conserving fixtures (e.g., water closets, urinals) or nonpotable water (e.g., captured rainwater, recycled graywater, on-site or municipally treated wastewater).

OR

OPTION 2

Treat 50% of wastewater on-site to tertiary standards. Treated water must be infiltrated or used on-site.

Potential Technologies & Strategies

Specify high-efficiency fixtures and dry fixtures (e.g., composting toilet systems, nonwater-using urinals) to reduce wastewater volumes. Consider reusing stormwater or graywater for sewage conveyance or on-site mechanical and/or natural wastewater treatment systems. Options for on-site wastewater treatment include packaged biological nutrient removal systems, constructed wetlands and high-efficiency filtration systems.

WE Credit 3: Water Use Reduction

2–4 Points

Intent

To further increase water efficiency within buildings to reduce the burden on municipal water supply and wastewater systems.

Requirements

Employ strategies that in aggregate use less water than the water use baseline calculated for the building (not including irrigation). The minimum water savings percentage for each point threshold is as follows:

Percentage Reduction	Points
30%	2
35%	3
40%	4

Calculate the baseline according to the commercial and/or residential baselines outlined below.¹ Calculations are based on estimated occupant usage and must include only the following fixtures and fixture fittings (as applicable to the project scope): water closets, urinals, lavatory faucets, showers, kitchen sink faucets and pre-rinse spray valves.

Commercial Fixtures, Fittings, and Appliances	Current Baseline (Imperial Units)	Current Baseline (Metric units)
Commercial toilets	1.6 gallons per flush (gpf)* Except blow-out fixtures: 3.5 (gpf)	6 liters per flush (lpf) Except blow-out fixtures: 13 lpf
Commercial urinals	1.0 (gpf)	4 lpf
Commercial lavatory (restroom) faucets	2.2 gallons per minute (gpm) at 60 pounds per square inch (psi), private applications only (hotel or motel guest rooms, hospital patient rooms) 0.5 (gpm) at 60 (psi)** all others except private applications 0.25 gallons per cycle for metering faucets	8.5 liters per minute (lpm) at 4 bar (58 psi), private applications only (hotel or motel guest rooms, hospital patient rooms) 2.0 lpm at 4 bar (58 psi), all others except private applications 1 liter per cycle for metering faucets
Showerheads	2.5 (gpm) at 80 (psi) per shower stall ****	9.5 lpm at 5 bar (58 psi)
For projects with commercial pre-rinse spray valves, the flow rate must comply with the ASME A112.18.1 standard of 1.6 gpm or less.		

¹ Tables adapted from information developed and summarized by the U.S. Environmental Protection Agency (EPA) Office of Water based on requirements of the Energy Policy Act (EPAct) of 1992 and subsequent rulings by the Department of Energy, requirements of the EPAct of 2005, and the plumbing code requirements as stated in the 2006 editions of the Uniform Plumbing Code or International Plumbing Code pertaining to fixture performance.

Residential Fixtures, Fittings, and Appliances	Current Baseline (Imperial units)	Current Baseline (Metric units)
Residential toilets	1.6 (gpf) ^{***}	6.1 liters per flush (lpf)
Residential lavatory (bathroom) faucets	2.2 (gpm) at 60 psi	8.5 lpm at 4 bar (58 psi)
Residential kitchen faucet		
Residential showerheads	2.5 (gpm) at 80 (psi) per shower stall ^{****}	9.5 lpm at 4 bar (58 psi)
<p>* EPA 1992 standard for toilets applies to both commercial and residential models.</p> <p>** In addition to EPA requirements, the American Society of Mechanical Engineers standard for public lavatory faucets is 0.5 gpm at 60 psi (2.0 lpm at 4 bar (58 psi)) (ASME A112.18.1-2005). This maximum has been incorporated into the national Uniform Plumbing Code and the International Plumbing Code.</p> <p>*** EPA 1992 standard for toilets applies to both commercial and residential models.</p> <p>**** Residential shower compartment (stall) in dwelling units: The total allowable flow rate from all flowing showerheads at any given time, including rain systems, waterfalls, bodysprays, bodyspas and jets, must be limited to the allowable showerhead flow rate as specified above (2.5 gpm) per shower compartment, where the floor area of the shower compartment is less than 2,500 square inches (1.5 square meters). For each increment of 2,500 square inches (1.5 square meters) of floor area thereafter or part thereof, an additional showerhead with total allowable flow rate from all flowing devices equal to or less than the allowable flow rate as specified above must be allowed. Exception: Showers that emit recirculated nonpotable water originating from within the shower compartment while operating are allowed to exceed the maximum as long as the total potable water flow does not exceed the flow rate as specified above.</p>		

The following fixtures, fittings and appliances are outside the scope of the water use reduction calculation:

- Commercial Steam Cookers
- Commercial Dishwashers
- Automatic Commercial Ice Makers
- Commercial (family-sized) Clothes Washers
- Residential Clothes Washers
- Standard and Compact Residential Dishwashers

Potential Technologies & Strategies

Use WaterSense-certified fixtures and fixture fittings where available. Use high-efficiency fixtures (e.g., water closets and urinals) and dry fixtures, such as toilets attached to composting systems, to reduce the potable water demand. Consider using alternative on-site sources of water (e.g., rainwater, stormwater, and air conditioner condensate, graywater) for nonpotable applications (e.g., toilet and urinal flushing, custodial uses). The quality of any alternative source of water being used must be taken into consideration based on its application or use.

ENERGY & ATMOSPHERE

EA Prerequisite 1: Fundamental Commissioning of Building Energy Systems

Required

Intent

To verify that the project's energy-related systems are installed, and calibrated to perform according to the owner's project requirements, basis of design and construction documents.

Benefits of commissioning include reduced energy use, lower operating costs, fewer contractor callbacks, better building documentation, improved occupant productivity and verification that the systems perform in accordance with the owner's project requirements.

Requirements

The following commissioning process activities must be completed by the project team:

- Designate an individual as the commissioning authority (CxA) to lead, review and oversee the completion of the commissioning process activities.
 - The CxA must have documented commissioning authority experience in at least 2 building projects.
 - The individual serving as the CxA must be independent of the project design and construction management, though the CxA may be an employee of any firm providing those services. The CxA may be a qualified employee or consultant of the owner.
 - The CxA must report results, findings and recommendations directly to the owner.
 - For projects smaller than 50,000 gross square feet (5,000 gross square meters), the CxA may be a qualified person on the design or construction team who has the required experience.
- The owner must document the owner's project requirements. The design team must develop the basis of design. The CxA must review these documents for clarity and completeness. The owner and design team must be responsible for updates to their respective documents.
- Develop and incorporate commissioning requirements into the construction documents.
- Develop and implement a commissioning plan.
- Verify the installation and performance of the systems to be commissioned.
- Complete a summary commissioning report.

Commissioned Systems

Commissioning process activities must be completed for the following energy-related systems, at a minimum:

- Heating, ventilating, air conditioning and refrigeration (HVAC&R) systems (mechanical and passive) and associated controls
- Lighting and daylighting controls
- Domestic hot water systems
- Renewable energy systems (e.g., wind, solar)

Potential Technologies & Strategies

Engage a CxA as early as possible in the design process. Determine the owner's project requirements, develop and maintain a commissioning plan for use during design and construction and incorporate commissioning requirements in bid documents. Assemble the commissioning team, and prior to occupancy verify the performance of energy consuming systems. Complete the commissioning reports with recommendations prior to accepting the commissioned systems.

Owners are encouraged to seek out qualified individuals to lead the commissioning process. Qualified individuals are identified as those who possess a high level of experience in the following areas:

- Energy systems design, installation and operation
- Commissioning planning and process management
- Hands-on field experience with energy systems performance, interaction, start-up, balancing, testing, troubleshooting, operation and maintenance procedures
- Energy systems automation control knowledge

Owners are encouraged to consider including water-using systems, building envelope systems, and other systems in the scope of the commissioning plan as appropriate. The building envelope is an important component of a facility that impacts energy consumption, occupant comfort and indoor air quality. While this prerequisite does not require building envelope commissioning, an owner can achieve significant financial savings and reduce risk of poor indoor air quality by including it in the commissioning process.

The LEED Reference Guide for Green Building Design and Construction, 2009 Edition provides guidance on the rigor expected for this prerequisite for the following:

- Owner's project requirements
- Basis of design
- Commissioning plan
- Commissioning specification
- Performance verification documentation
- Commissioning report

EA Prerequisite 2: Minimum Energy Performance

Required

Intent

To establish the minimum level of energy efficiency for the proposed building and systems to reduce environmental and economic impacts associated with excessive energy use.

Requirements

OPTION 1. Whole Building Energy Simulation

Demonstrate a 10% improvement in the proposed building performance rating for new buildings, or a 5% improvement in the proposed building performance rating for major renovations to existing buildings, compared with the baseline building performance rating.

Calculate the baseline building performance rating according to the building performance rating method in Appendix G of ANSI/ASHRAE/IESNA Standard 90.1-2007 (with errata but without addenda¹) using a computer simulation model for the whole building project.

Appendix G of Standard 90.1-2007 requires that the energy analysis done for the building performance rating method include all energy costs associated with the building project. To achieve points using this credit, the proposed design must meet the following criteria:

- Comply with the mandatory provisions (Sections 5.4, 6.4, 7.4, 8.4, 9.4 and 10.4) in Standard 90.1-2007 (with errata but without addenda¹).
- Include all energy costs associated with the building project.
- Compare against a baseline building that complies with Appendix G of Standard 90.1-2007 (with errata but without addenda¹). The default process energy cost is 25% of the total energy cost for the baseline building. If the building's process energy cost is less than 25% of the baseline building energy cost, the LEED submittal must include documentation substantiating that process energy inputs are appropriate.

For the purpose of this analysis, process energy is considered to include, but is not limited to, office and general miscellaneous equipment, computers, elevators and escalators, kitchen cooking and refrigeration, laundry washing and drying, lighting exempt from the lighting power allowance (e.g., lighting integral to medical equipment) and other (e.g., waterfall pumps).

Regulated (non-process) energy includes lighting (for the interior, parking garage, surface parking, façade, or building grounds, etc. except as noted above), heating, ventilation and air conditioning (HVAC) (for space heating, space cooling, fans, pumps, toilet exhaust, parking garage ventilation, kitchen hood exhaust, etc.), and service water heating for domestic or space heating purposes.

Process loads must be identical for both the baseline building performance rating and the proposed building performance rating. However, project teams may follow the exceptional calculation method (ANSI/ASHRAE/IESNA Standard 90.1-2007 G2.5) to document measures that reduce process loads. Documentation of process

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

load energy savings must include a list of the assumptions made for both the base and the proposed design, and theoretical or empirical information supporting these assumptions.

Projects in California may use Title 24-2005, Part 6 in place of ANSI/ASHRAE/IESNA Standard 90.1-2007 for Option 1.

OR

OPTION 2. Prescriptive Compliance Path: ASHRAE Advanced Energy Design Guide

This OPTION is not available to Projects outside the U.S.

Comply with the prescriptive measures of the ASHRAE Advanced Energy Design Guide appropriate to the project scope, outlined below. Project teams must comply with all applicable criteria as established in the Advanced Energy Design Guide for the climate zone in which the building is located.

PATH 1. ASHRAE Advanced Energy Design Guide for Small Office Buildings 2004

The building must meet the following requirements:

- Less than 20,000 square feet (2,000 square meters).
- Office occupancy.

PATH 2. ASHRAE Advanced Energy Design Guide for Small Retail Buildings 2006

The building must meet the following requirements:

- Less than 20,000 square feet (2,000 square meters).
- Retail occupancy.

PATH 3. ASHRAE Advanced Energy Design Guide for Small Warehouses and Self Storage Buildings 2008

The building must meet the following requirements:

- Less than 50,000 square feet (5,000 square meters).
- Warehouse or self-storage occupancy.

OR

OPTION 3. Prescriptive Compliance Path: Advanced Buildings™ Core Performance™ Guide

This OPTION is not available to Projects outside the U.S.

Comply with the prescriptive measures identified in the Advanced Buildings™ Core Performance™ Guide developed by the New Buildings Institute. The building must meet the following requirements:

- Less than 100,000 square feet (10,000 square meters).
- Comply with Section 1: Design Process Strategies, and Section 2: Core Performance Requirements.
- Health care, warehouse and laboratory projects are ineligible for this path.

OR



Alternative Compliance Path for Projects Outside the U.S.

Demonstrate performance that is equivalent to the above requirements by substituting appropriate benchmarks, protocols and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. Analysis showing that a local standard is equivalent to the requirements of ASHRAE 90.1-2007 must be done by a World Green Building Council *member organization* that is an active participant on the LEED International Roundtable. The WGBC *member organization* must contact USGBC before conducting the analysis which must be done before submitting a project for certification. This analysis will need to be approved by USGBC before a project submits this ACP for certification.

Potential Potential Technologies & Strategies

Design the building envelope and systems to meet baseline requirements. Use a computer simulation model to assess the energy performance and identify the most cost-effective energy efficiency measures. Quantify energy performance compared with a baseline building.

If local code has demonstrated quantitative and textual equivalence following, at a minimum, the U.S. Department of Energy (DOE) standard process for commercial energy code determination, then the results of that analysis may be used to correlate local code performance with ANSI/ASHRAE/IESNA Standard 90.1-2007. Details on the DOE process for commercial energy code determination can be found at http://www.energycodes.gov/implementation/determinations_com.stm.

EA Prerequisite 3: Fundamental Refrigerant Management

Required

Intent

To reduce stratospheric ozone depletion.

Requirements

Zero use of chlorofluorocarbon (CFC)-based refrigerants in new base building heating, ventilating, air conditioning and refrigeration (HVAC&R) systems. When reusing existing base building HVAC equipment, complete a comprehensive CFC phase-out conversion prior to project completion. Phase-out plans extending beyond the project completion date will be considered on their merits.

Existing small HVAC units (defined as containing less than 0.5 pounds (228 grams) of refrigerant) and other equipment, such as standard refrigerators, small water coolers and any other equipment that contains less than 0.5 pounds (228 grams) of refrigerant, are not considered part of the base building system and are not subject to the requirements of this prerequisite.

Potential Technologies & Strategies

When reusing existing HVAC systems, conduct an inventory to identify equipment that uses CFC-based refrigerants and provide a replacement schedule for these refrigerants. For new buildings, specify new HVAC equipment in the base building that uses no CFC-based refrigerants.

EA Credit 1: Optimize Energy Performance

1–19 Points

Intent

To achieve increasing levels of energy performance beyond the prerequisite standard to reduce environmental and economic impacts associated with excessive energy use.

Requirements

Select 1 of the 3 compliance path options described below. Project teams documenting achievement using any of the 3 options are assumed to be in compliance with EA Prerequisite 2: Minimum Energy Performance.

OPTION 1. Whole Building Energy Simulation (1–19 points)

Demonstrate a percentage improvement in the proposed building performance rating compared with the baseline building performance rating. Calculate the baseline building performance according to Appendix G of ANSI/ASHRAE/IESNA Standard 90.1-2007 (with errata but without addenda¹) using a computer simulation model for the whole building project. The minimum energy cost savings percentage for each point threshold is as follows:

New Buildings	Existing Building Renovations	Points
12%	8%	1
14%	10%	2
16%	12%	3
18%	14%	4
20%	16%	5
22%	18%	6
24%	20%	7
26%	22%	8
28%	24%	9
30%	26%	10
32%	28%	11
34%	30%	12
36%	32%	13
38%	34%	14
40%	36%	15
42%	38%	16
44%	40%	17
46%	42%	18
48%	44%	19

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

Appendix G of Standard 90.1-2007 requires that the energy analysis done for the building performance rating method include all the energy costs associated with the building project. To achieve points under this credit, the proposed design must meet the following criteria:

- Compliance with the mandatory provisions (Sections 5.4, 6.4, 7.4, 8.4, 9.4 and 10.4) in Standard 90.1-2007 (with errata but without addenda).
- Inclusion of all the energy costs within and associated with the building project.
- Comparison against a baseline building that complies with Appendix G of Standard 90.1-2007 (with errata but without addenda). The default process energy cost is 25% of the total energy cost for the baseline building. If the building's process energy cost is less than 25% of the baseline building energy cost, the LEED submittal must include documentation substantiating that process energy inputs are appropriate.

For the purpose of this analysis, process energy is considered to include, but is not limited to, office and general miscellaneous equipment, computers, elevators and escalators, kitchen cooking and refrigeration, laundry washing and drying, lighting exempt from the lighting power allowance (e.g., lighting integral to medical equipment) and other (e.g., waterfall pumps).

Regulated (non-process) energy includes lighting (e.g., for the interior, parking garage, surface parking, façade, or building grounds, etc. except as noted above), heating, ventilating, and air conditioning (HVAC) (e.g., for space heating, space cooling, fans, pumps, toilet exhaust, parking garage ventilation, kitchen hood exhaust, etc.), and service water heating for domestic or space heating purposes.

For this credit, process loads must be identical for both the baseline building performance rating and the proposed building performance rating. However, project teams may follow the exceptional calculation method (ANSI/ASHRAE/IESNA Standard 90.1-2007 G2.5) to document measures that reduce process loads. Documentation of process load energy savings must include a list of the assumptions made for both the base and proposed design, and theoretical or empirical information supporting these assumptions.

Projects in California may use Title 24-2005, Part 6 in place of ANSI/ASHRAE/IESNA Standard 90.1-2007 for Option 1.

OR

OPTION 2. Prescriptive Compliance Path: ASHRAE Advanced Energy Design Guide (1 point)

This OPTION is not available to Projects outside the U.S.

Comply with the prescriptive measures of the ASHRAE Advanced Energy Design Guide appropriate to the project scope, outlined below. Project teams must comply with all applicable criteria as established in the Advanced Energy Design Guide for the climate zone in which the building is located.

PATH 1. ASHRAE Advanced Energy Design Guide for Small Office Buildings 2004

The building must meet the following requirements:

- Less than 20,000 square feet (2,000 square meters).
- Office occupancy.

PATH 2. ASHRAE Advanced Energy Design Guide for Small Retail Buildings 2006

The building must meet the following requirements:

- Less than 20,000 square feet (2,000 square meters).
- Retail occupancy.

PATH 3. ASHRAE Advanced Energy Design Guide for Small Warehouses and Self Storage Buildings 2008

The building must meet the following requirements:

- Less than 50,000 square feet (5,000 square meters).
- Warehouse or self-storage occupancy.

OR

OPTION 3. Prescriptive Compliance Path: Advanced Buildings™ Core Performance™ Guide (1–3 points)

This OPTION is not available to Projects outside the U.S.

Comply with the prescriptive measures identified in the Advanced Buildings™ Core Performance™ Guide developed by the New Buildings Institute. The building must meet the following requirements:

- Less than 100,000 square feet (10,000 square meters).
- Comply with Section 1: Design Process Strategies, and Section 2: Core Performance Requirements.
- Health care, warehouse or laboratory projects are ineligible for this path.

Points achieved under Option 3 (1 point):

- 1 point is available for all projects (office, school, public assembly, and retail projects) less than 100,000 square feet (10,000 square meters) that comply with Sections 1 and 2 of the Core Performance Guide.
- Up to 2 additional points are available to projects that implement performance strategies listed in Section 3, Enhanced Performance. For every 3 strategies implemented from this section, 1 point is available.
- The following strategies are addressed by other aspects of LEED and are not eligible for additional points under EA Credit 1:
 - 3.1 — Cool Roofs
 - 3.8 — Night Venting
 - 3.13 — Additional Commissioning



OR

Alternative Compliance Path for Projects Outside the U.S.

Demonstrate performance that is equivalent to the above requirements by substituting appropriate benchmarks, protocols and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. Analysis showing that a local standard is equivalent to the requirements of ASHRAE 90.1-2007 must be done by a World Green Building Council *member organization* that is an active participant on the LEED International Roundtable. The WGBC *member organization* must contact USGBC before conducting the analysis which must be done before submitting a project for certification. This analysis will need to be approved by USGBC before a project submits this ACP for certification.

Potential Technologies & Strategies

Design the building envelope and systems to maximize energy performance. Use a computer simulation model to assess the energy performance and identify the most cost-effective energy efficiency measures. Quantify energy performance compared with a baseline building.

If local code has demonstrated quantitative and textual equivalence following, at a minimum, the U.S. Department of Energy (DOE) standard process for commercial energy code determination, the results of that analysis may be used to correlate local code performance with ANSI/ASHRAE/IESNA Standard 90.1-2007. Details on the DOE process for commercial energy code determination can be found at http://www.energycodes.gov/implement/determinations_com.stm.

EA Credit 2: On-site Renewable Energy

1–7 Points

Intent

To encourage and recognize increasing levels of on-site renewable energy self-supply to reduce environmental and economic impacts associated with fossil fuel energy use.

Requirements

Use on-site renewable energy systems to offset building energy costs. Calculate project performance by expressing the energy produced by the renewable systems as a percentage of the building's annual energy cost and use the table below to determine the number of points achieved.

Use the building annual energy cost calculated in EA Credit 1: Optimize Energy Performance or the U.S. Department of Energy's Commercial Buildings Energy Consumption Survey (CBECS) database to determine the estimated electricity use.

Projects outside the U.S. may not use the CBECS option.

The minimum renewable energy percentage for each point threshold is as follows:

Percentage Renewable Energy	Points
1%	1
3%	2
5%	3
7%	4
9%	5
11%	6
13%	7

Potential Technologies & Strategies

Assess the project for nonpolluting and renewable energy potential including solar, wind, geothermal, low-impact hydro, biomass and bio-gas strategies. When applying these strategies, take advantage of net metering with the local utility.

EA Credit 3: Enhanced Commissioning

2 Points

Intent

To begin the commissioning process early in the design process and execute additional activities after systems performance verification is completed.

Requirements

Implement, or have a contract in place to implement, the following additional commissioning process activities in addition to the requirements of EA Prerequisite 1: Fundamental Commissioning of Building Energy Systems and in accordance with the LEED Reference Guide for Green Building Design and Construction, 2009 Edition:

- Prior to the start of the construction documents phase, designate an independent commissioning authority (CxA) to lead, review and oversee the completion of all commissioning process activities.
 - The CxA must have documented commissioning authority experience in at least 2 building projects.
 - The individual serving as the CxA:
 - Must be independent of the work of design and construction.
 - Must not be an employee of the design firm, though he or she may be contracted through them.
 - Must not be an employee of, or contracted through, a contractor or construction manager holding construction contracts.
 - May be a qualified employee or consultant of the owner.
 - The CxA must report results, findings and recommendations directly to the owner.
- The CxA must conduct, at a minimum, 1 commissioning design review of the owner's project requirements basis of design, and design documents prior to the mid-construction documents phase and back-check the review comments in the subsequent design submission.
- The CxA must review contractor submittals applicable to systems being commissioned for compliance with the owner's project requirements and basis of design. This review must be concurrent with the review of the architect or engineer of record and submitted to the design team and the owner.
- The CxA or other project team members must develop a systems manual that gives future operating staff the information needed to understand and optimally operate the commissioned systems.
- The CxA or other project team members must verify that the requirements for training operating personnel and building occupants have been completed.
- The CxA must be involved in reviewing the operation of the building with operations and maintenance (O&M) staff and occupants within 10 months after substantial completion. A plan for resolving outstanding commissioning-related issues must be included.

Potential Technologies & Strategies

Although it is preferable that the CxA be contracted by the owner, for the enhanced commissioning credit the CxA may also be contracted through the design firms or construction management firms not holding construction contracts.

The LEED Reference Guide for Green Building Design and Construction, 2009 Edition provides detailed guidance on the rigor expected for the following process activities:

- Commissioning design review
- Commissioning submittal review
- Systems manual.

EA Credit 4: Enhanced Refrigerant Management

2 Points

Intent

To reduce ozone depletion and support early compliance with the Montreal Protocol while minimizing direct contributions to climate change.

Requirements

OPTION 1

Do not use refrigerants.

OR

OPTION 2

Select refrigerants and heating, ventilation, air conditioning and refrigeration (HVAC&R) equipment that minimize or eliminate the emission of compounds that contribute to ozone depletion and climate change. The base building HVAC&R equipment must comply with the following formula, which sets a maximum threshold for the combined contributions to ozone depletion and global warming potential:

Imperial units	Metric units
$LCGWP + LCODP \times 10^5 \leq 100$	$LCGWP + LCODP \times 10^5 \leq 13$
Calculation definitions for $LCGWP + LCODP \times 10^5 \leq 100$ (Imperial units)	Calculation definitions for $LCGWP + LCODP \times 10^5 \leq 13$ (Metric units)
$LCODP = [ODPr \times (Lr \times Life + Mr) \times Rc] / Life$	$LCODP = [ODPr \times (Lr \times Life + Mr) \times Rc] / Life$
$LCGWP = [GWPr \times (Lr \times Life + Mr) \times Rc] / Life$	$LCGWP = [GWPr \times (Lr \times Life + Mr) \times Rc] / Life$
LCODP: Lifecycle Ozone Depletion Potential (lb CFC 11/Ton-Year)	LCODP: Lifecycle Ozone Depletion Potential (kg CFC 11/(kW/year))
LCGWP: Lifecycle Direct Global Warming Potential (lb CO ₂ /Ton-Year)	LCGWP: Lifecycle Direct Global Warming Potential (kg CO ₂ /(kW/year))
GWPr: Global Warming Potential of Refrigerant (0 to 12,000 lb CO ₂ /lbr)	ODPr: Ozone Depletion Potential of Refrigerant (0 to 0.2 kg CFC 11/kg r)
ODPr: Ozone Depletion Potential of Refrigerant (0 to 0.2 lb CFC 11/lbr)	GWPr: Global Warming Potential of Refrigerant (0 to 12,000 kg CO ₂ /kg r)
Lr: Refrigerant Leakage Rate (0.5% to 2.0%; default of 2% unless otherwise demonstrated)	Lr: Refrigerant Leakage Rate (0.5% to 2.0%; default of 2% unless otherwise demonstrated)
Mr: End-of-life Refrigerant Loss (2% to 10%; default of 10% unless otherwise demonstrated)	Mr: End-of-life Refrigerant Loss (2% to 10%; default of 10% unless otherwise demonstrated)
Rc: Refrigerant Charge (0.5 to 5.0 lbs of refrigerant per ton of gross ARI rated cooling capacity)	Rc: Refrigerant Charge (0.065 to 0.65 kg of refrigerant per kW of ARI rated or Eurovent Certified cooling capacity)
Life: Equipment Life (10 years; default based on equipment type, unless otherwise demonstrated)	Life: Equipment Life (default based on equipment type, unless otherwise demonstrated)

For multiple types of equipment, a weighted average of all base building HVAC&R equipment must be calculated using the following formula:

Imperial units	Metric units
$\frac{\sum (\text{LCGWP} + \text{LCODP} \times 10^5) \times \text{Qunit}}{\text{Qtotal}} \leq 100$	$\frac{\sum (\text{LCGWP} + \text{LCODP} \times 10^5) \times \text{Qunit}}{\text{Qtotal}} \leq 13$

Calculation definitions for [$\sum (\text{LCGWP} + \text{LCODP} \times 10^5) \times \text{Qunit}$] / $\text{Qtotal} \leq 100$ (Imperial units)	Calculation definitions for [$\sum (\text{LCGWP} + \text{LCODP} \times 10^5) \times \text{Qunit}$] / $\text{Qtotal} \leq 13$ (Metric units)
Qunit = Gross ARI rated cooling capacity of an individual HVAC or refrigeration unit (Tons)	Qunit = Eurovent Certified cooling capacity of an individual HVAC or refrigeration unit (kW)
Qtotal = Total gross ARI rated cooling capacity of all HVAC or refrigeration	Qtotal = Total Eurovent Certified cooling capacity of all HVAC or refrigeration (kW)

Small HVAC units (defined as containing less than 0.5 pounds (228 grams) of refrigerant) and other equipment, such as standard refrigerators, small water coolers and any other cooling equipment that contains less than 0.5 pounds (228 grams) of refrigerant, are not considered part of the base building system and are not subject to the requirements of this credit.

Do not operate or install fire suppression systems that contain ozone-depleting substances such as CFCs, hydrochlorofluorocarbons (HCFCs) or halons.

Potential Technologies & Strategies

Design and operate the facility without mechanical cooling and refrigeration equipment. Where mechanical cooling is used, utilize base building HVAC&R systems for the refrigeration cycle that minimize direct impact on ozone depletion and global climate change. Select HVAC&R equipment with reduced refrigerant charge and increased equipment life. Maintain equipment to prevent leakage of refrigerant to the atmosphere. Use fire suppression systems that do not contain HCFCs or halons.

EA Credit 5: Measurement and Verification

3 Points

Intent

To provide for the ongoing accountability of building energy consumption over time.

Requirements

OPTION 1

Develop and implement a measurement and verification (M&V) plan consistent with Option D: Calibrated Simulation (Savings Estimation Method 2) as specified in the International Performance Measurement & Verification Protocol (IPMVP) Volume III: Concepts and Options for Determining Energy Savings in New Construction, April 2003.

The M&V period must cover at least 1 year of post-construction occupancy.

Provide a process for corrective action if the results of the M&V plan indicate that energy savings are not being achieved.

OR

OPTION 2

Develop and implement a measurement and verification (M&V) plan consistent with Option B: Energy Conservation Measure Isolation, as specified in the International Performance Measurement & Verification Protocol (IPMVP) Volume III: Concepts and Options for Determining Energy Savings in New Construction, April 2003.

The M&V period must cover at least 1 year of post-construction occupancy.

Provide a process for corrective action if the results of the M&V plan indicate that energy savings are not being achieved.

OR

OPTION 3 (1 point)

Meet MPR 6 through compliance Option 1: Energy and Water Data Release Form. Projects must register an account in ENERGY STAR's Portfolio Manager tool and share the project file with the USGBC master account.

Potential Technologies & Strategies

Develop an M&V plan to evaluate building and/or energy system performance. Characterize the building and/or energy systems through energy simulation or engineering analysis. Install the necessary metering equipment to measure energy use. Track performance by comparing predicted performance to actual performance, broken down by component or system as appropriate. Evaluate energy efficiency by comparing actual performance to baseline performance.

While the IPMVP describes specific actions for verifying savings associated with energy conservation measures (ECMs) and strategies, this LEED credit expands upon typical IPMVP M&V objectives. Measurement & verification activities should not necessarily be confined to energy systems where ECMs or energy conservation strategies have been implemented. The IPMVP provides guidance on M&V strategies and their appropriate applications for various situations. These strategies should be used in conjunction with monitoring and trend logging of significant energy systems to provide for the ongoing accountability of building energy performance.

For the corrective action process, consider installing diagnostics within the control system to alert the staff when equipment is not being optimally operated. Conditions that might warrant alarms to alert staff could include:

- Leaking valves in the cooling and heating coils within air handling units;
- Missed economizer opportunities (e.g., faulty economizer damper controls) ;
- Software and manual overrides allowing equipment to operate 24 hours a day/7 days a week;
- Equipment operation during unusual circumstances (e.g., boiler on when outside air temperature is above 65 °F (18°C)).

Besides control diagnostics, consider employing retro-commissioning services or dedicating staff to investigate increases in energy usage (such a staff member is usually a resource conservation manager — see <http://www.energy.state.or.us/rcm/rcmhm.htm> for additional information).

EA Credit 6: Green Power

2 Points

Intent

To encourage the development and use of grid-source, renewable energy technologies on a net zero pollution basis.

Requirements

Engage in at least a 2-year renewable energy contract to provide at least 35% of the building's electricity from renewable sources, as defined by the Center for Resource Solutions' Green-e Energy product certification requirements.

All purchases of green power shall be based on the quantity of energy consumed, not the cost.

OPTION 1. Determine Baseline Electricity Use

Use the annual electricity consumption from the results of EA Credit 1: Optimize Energy Performance.

OR

OPTION 2. Estimate Baseline Electricity Use

This OPTION is not available to Projects outside the U.S.

Use the U.S. Department of Energy's Commercial Buildings Energy Consumption Survey (CBECS) database to determine the estimated electricity use.

Note for Projects Outside the U.S.

If renewable energy is not Green-e certified, establish that it is equivalent for the 2 major criteria for Green-e Energy certification: (1) the energy source meets the requirements for renewable resources detailed in the current version of the Green-e standard, and (2) the renewable energy supplier has undergone an independent, third-party verification that the standard has been met. The current version of the standard is available on the Green-e website (<http://www.green-e.org>). The third-party verification process must be as rigorous as that used in the Green-e certification process, and it must be performed annually.

Potential Technologies & Strategies

Determine the energy needs of the building and investigate opportunities to engage in a green power contract. Green power is derived from solar, wind, geothermal, biomass or low-impact hydro sources. Visit <http://www.green-e.org/energy> for details about the Green-e Energy program. The green power product purchased to comply with credit requirements need not be Green-e Energy certified. Other sources of green power are eligible if they satisfy the Green-e Energy program's technical requirements. Renewable energy certificates (RECs), tradable renewable certificates (TRCs), green tags and other forms of green power that comply with the technical requirements of the Green-e Energy program may be used to document compliance with this credit.

MATERIALS & RESOURCES

MR Prerequisite 1: Storage and Collection of Recyclables

Required

Intent

To facilitate the reduction of waste generated by building occupants that is hauled to and disposed of in landfills.

Requirements

Provide an easily-accessible dedicated area or areas for the collection and storage of materials for recycling for the entire building. Materials must include, at a minimum: paper, corrugated cardboard, glass, plastics and metals.

Potential Technologies & Strategies

Designate an area for recyclable collection and storage that is appropriately sized and located in a convenient area. Identify local waste handlers and buyers for glass, plastic, metals, office paper, newspaper, cardboard and organic wastes. Instruct occupants on recycling procedures. Consider employing cardboard balers, aluminum can crushers, recycling chutes and other waste management strategies to further enhance the recycling program.

MR Credit 1.1: Building Reuse—Maintain Existing Walls, Floors and Roof

1–3 Points

Intent

To extend the lifecycle of existing building stock, conserve resources, retain cultural resources, reduce waste and reduce environmental impacts of new buildings as they relate to materials manufacturing and transport.

Requirements

Maintain the existing building structure (including structural floor and roof decking) and envelope (the exterior skin and framing, excluding window assemblies and non-structural roofing material). The minimum percentage building reuse for each point threshold is as follows:

Building Reuse	Points
55%	1
75%	2
95%	3

Hazardous materials that are remediated as a part of the project must be excluded from the calculation of the percentage maintained. If the project includes an addition that is more than 2 times the floor area of the existing building, this credit is not applicable.

Potential Technologies & Strategies

Consider reusing existing, previously-occupied building structures, envelopes and elements. Remove elements that pose a contamination risk to building occupants and upgrade components that would improve energy and water efficiency such as windows, mechanical systems and plumbing fixtures.

MR Credit 1.2: Building Reuse—Maintain Interior Nonstructural Elements

1 Point

Intent

To extend the lifecycle of existing building stock, conserve resources, retain cultural resources, reduce waste and reduce environmental impacts of new buildings as they relate to materials manufacturing and transport.

Requirements

Use existing interior nonstructural elements (e.g., interior walls, doors, floor coverings and ceiling systems) in at least 50% (by area) of the completed building, including additions. If the project includes an addition with floor area more than 2 times the floor area of the existing building, this credit is not applicable.

Potential Technologies & Strategies

Consider reusing existing building structures, envelopes and interior nonstructural elements. Remove elements that pose a contamination risk to building occupants, and upgrade components that would improve energy and water efficiency such as mechanical systems and plumbing fixtures. Quantify the extent of building reuse.

MR Credit 2: Construction Waste Management

1–2 Points

Intent

To divert construction and demolition debris from disposal in landfills and incineration facilities. Redirect recyclable recovered resources back to the manufacturing process and reusable materials to appropriate sites.

Requirements

Recycle and/or salvage nonhazardous construction and demolition debris. Develop and implement a construction waste management plan that, at a minimum, identifies the materials to be diverted from disposal and whether the materials will be sorted on-site or comingled. Excavated soil and land-clearing debris do not contribute to this credit. Calculations can be done by weight or volume, but must be consistent throughout. The minimum percentage debris to be recycled or salvaged for each point threshold is as follows:

Recycled or Salvaged	Points
50%	1
75%	2

Potential Technologies & Strategies

Establish goals for diversion from disposal in landfills and incineration facilities and adopt a construction waste management plan to achieve these goals. Consider recycling cardboard, metal, brick, mineral fiber panel, concrete, plastic, clean wood, glass, gypsum wallboard, carpet and insulation. Construction debris processed into a recycled content commodity that has an open market value (e.g., wood derived fuel [WDF], alternative daily cover material, etc.) may be applied to the construction waste calculation. Designate a specific area(s) on the construction site for segregated or comingled collection of recyclable materials, and track recycling efforts throughout the construction process. Identify construction haulers and recyclers to handle the designated materials. Note that diversion may include donation of materials to charitable organizations and salvage of materials on-site.

MR Credit 3: Materials Reuse

1–2 Points

Intent

To reuse building materials and products to reduce demand for virgin materials and reduce waste, thereby lessening impacts associated with the extraction and processing of virgin resources.

Requirements

Use salvaged, refurbished or reused materials, the sum of which constitutes at least 5% or 10%, based on cost, of the total value of materials on the project. The minimum percentage materials reused for each point threshold is as follows:

Reused Materials	Points
5%	1
10%	2

Mechanical, electrical and plumbing components and specialty items such as elevators and equipment cannot be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Identify opportunities to incorporate salvaged materials into the building design, and research potential material suppliers. Consider salvaged materials such as beams and posts, flooring, paneling, doors and frames, cabinetry and furniture, brick, and decorative items.

MR Credit 4: Recycled Content

1–2 Points

Intent

To increase demand for building products that incorporate recycled content materials, thereby reducing impacts resulting from extraction and processing of virgin materials.

Requirements

Use materials with recycled content¹ such that the sum of postconsumer² recycled content plus 1/2 of the preconsumer³ content constitutes at least 10% or 20%, based on cost, of the total value of the materials in the project. The minimum percentage materials recycled for each point threshold is as follows:

Recycled Content	Points
10%	1
20%	2

The recycled content value of a material assembly is determined by weight. The recycled fraction of the assembly is then multiplied by the cost of assembly to determine the recycled content value.

Mechanical, electrical and plumbing components and specialty items such as elevators cannot be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Establish a project goal for recycled content materials, and identify material suppliers that can achieve this goal. During construction, ensure that the specified recycled content materials are installed. Consider a range of environmental, economic and performance attributes when selecting products and materials.

- ¹ Recycled content is defined in accordance with the International Organization of Standards document, ISO 14021 — Environmental labels and declarations — Self-declared environmental claims (Type II environmental labeling).
- ² Postconsumer material is defined as waste material generated by households or by commercial, industrial and institutional facilities in their role as end-users of the product, which can no longer be used for its intended purpose.
- ³ Preconsumer material is defined as material diverted from the waste stream during the manufacturing process. Reutilization of materials (i.e., rework, regrind or scrap generated in a process and capable of being reclaimed within the same process that generated it) is excluded.

MR Credit 5: Regional Materials

1–2 Points

Intent

To increase demand for building materials and products that are extracted and manufactured within the region, thereby supporting the use of indigenous resources and reducing the environmental impacts resulting from transportation.

Requirements

Use building materials or products that have been extracted, harvested or recovered, as well as manufactured, within 500 miles (800 kilometers) of the project site for a minimum of 10% or 20%, based on cost, of the total materials value. If only a fraction of a product or material is extracted, harvested, or recovered and manufactured locally, then only that percentage (by weight) can contribute to the regional value. The minimum percentage regional materials for each point threshold is as follows:

Regional Materials	Points
10%	1
20%	2

Mechanical, electrical and plumbing components and specialty items such as elevators and equipment must not be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

OR



Alternative Compliance Path for Projects Outside the U.S.

Use building materials or products that have been extracted, harvested or recovered, as well as manufactured, within regional distances of the project site for a minimum of 10% or 20%, based on cost, of the total materials value. If only a fraction of a product or material is extracted, harvested, or recovered and manufactured locally, then only that percentage (by weight) can contribute to the regional value. Regional distances are defined by the following options:

OPTION 1

Within a radius of 500 miles (800 kilometers) from the project site.

OR

OPTION 2

For building materials or products shipped in part by rail or water, the total distance to the project shall be determined by weighted average, whereby the portion of the distance transported by rail is divided by 3, the portion of the distance transported by inland waterways is divided by 2, the portion of the distance transported by sea is divided by 15, and added to the portion of the distance transported by any other means other than by rail, inland waterways, sea, or road, provided the total weighted average distance does not exceed 500 miles (800 kilometers).

For building materials or products shipped in part by rail or water, determine the total distance to the project using the following formula:

$(\text{Distance by rail}/3) + (\text{Distance by inland waterways}/2) + (\text{Distance by sea}/15) + (\text{Distance by means other than rail, inland waterways or sea}) \leq 500 \text{ miles [800 kilometers]}$

For example, if a product is manufactured in City X, transported by rail 200 miles (300 kilometers) to Seaport Y, shipped 2,800 miles (4,500 kilometers) to Seaport Z, and transported by truck 220 miles (350 kilometers) to the project site, the effective distance is 480 miles (750 kilometers):

$200 \text{ miles}/3 [300 \text{ kilometers}/3] + 2,800 \text{ miles}/15 [4,500 \text{ kilometers}/15] + 220 \text{ miles [350 kilometers]} = 480 \text{ miles [750 kilometers]}$

The effective distance is less than 500 miles (800 kilometers), and the purchase counts toward the credit.

Mechanical, electrical and plumbing components and specialty items such as elevators and equipment must not be included in this calculation. Include only materials permanently installed in the project.

Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Establish a project goal for locally sourced materials, and identify materials and material suppliers that can achieve this goal. During construction, ensure that the specified local materials are installed, and quantify the total percentage of local materials installed. Consider a range of environmental, economic and performance attributes when selecting products and materials.

MR Credit 6: Rapidly Renewable Materials

1 Point

Intent

To reduce the use and depletion of finite raw materials and long-cycle renewable materials by replacing them with rapidly renewable materials.

Requirements

Use rapidly renewable building materials and products for 2.5% of the total value of all building materials and products used in the project, based on cost. Rapidly renewable building materials and products are made from agricultural products that are typically harvested within a 10-year or shorter cycle.

Potential Technologies & Strategies

Establish a project goal for rapidly renewable materials, and identify products and suppliers that can support achievement of this goal. Consider materials such as bamboo, wool, cotton insulation, agrifiber, linoleum, wheatboard, strawboard and cork. During construction, ensure that the specified renewable materials are installed.

MR Credit 7: Certified Wood

1 Point

Intent

To encourage environmentally responsible forest management.

Requirements

Use a minimum of 50% (based on cost) of wood-based materials and products that are certified in accordance with the Forest Stewardship Council's principles and criteria, for wood building components. These components include at a minimum, structural framing and general dimensional framing, flooring, sub-flooring, wood doors and finishes.

Include only materials permanently installed in the project. Wood products purchased for temporary use on the project (e.g., formwork, bracing, scaffolding, sidewalk protection, and guard rails) may be included in the calculation at the project team's discretion. If any such materials are included, all such materials must be included in the calculation. If such materials are purchased for use on multiple projects, the applicant may include these materials for only one project, at its discretion. Furniture may be included if it is included consistently in MR Credits 3, Materials Reuse, through MR Credit 7, Certified Wood.

Potential Technologies & Strategies

Establish a project goal for FSC-certified wood products and identify suppliers that can achieve this goal. During construction, ensure that the FSC-certified wood products are installed and quantify the total percentage of FSC-certified wood products installed.

INDOOR ENVIRONMENTAL QUALITY

IEQ Prerequisite 1: Minimum Indoor Air Quality Performance

Required

Intent

To establish minimum indoor air quality (IAQ) performance to enhance indoor air quality in buildings, thus contributing to the comfort and well-being of the occupants.

Requirements

Meet the minimum requirements of Sections 4 through 7 of ASHRAE Standard 62.1-2007, Ventilation for Acceptable Indoor Air Quality (with errata but without addenda¹).

AND

CASE 1. Mechanically Ventilated Spaces

Mechanical ventilation systems must be designed using the ventilation rate procedure or the applicable local code, whichever is more stringent.

CASE 2. Naturally Ventilated Spaces

Naturally ventilated buildings must comply with ASHRAE Standard 62.1-2007, Paragraph 5.1 (with errata but without addenda¹).

OR

Alternative Compliance Path for Projects Outside the U.S.

OPTION 1

Meet the minimum requirements of Annex B of Comité Européen de Normalisation (CEN) Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics; and the requirements of CEN Standard EN 13779, Ventilation for nonresidential buildings, Performance requirements for ventilation and room conditioning systems.

OR

OPTION 2

Meet the minimum requirements of an equivalent local standard, and demonstrate performance that is equivalent to the requirements of ASHRAE Standard 62.1-2007, Ventilation for Acceptable Indoor Air Quality, Sections 4 through 7 (with errata but without addenda¹), by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this prerequisite may do so at their discretion. Addenda must be applied consistently across all LEED credits.



to this credit's requirements. The following general topics must be addressed to demonstrate equivalency with ASHRAE Standard 62.1-2007, Sections 4 through 7 (with errata but without addenda') :

- Outdoor air quality
- Systems and equipment
- Ventilation rate procedure and indoor air quality (IAQ) procedure
- Construction and system start-up

AND

CASE 1. Mechanically Ventilated Spaces

Mechanical ventilation systems must be designed using the ventilation rate procedure or the applicable local code, whichever is more stringent.

CASE 2. Naturally Ventilated Spaces

Naturally ventilated buildings must comply with a local standard that is equivalent to ASHRAE Standard 62.1-2007, Paragraph 5.1 (with errata but without addenda'). Demonstrate performance that is equivalent to the requirements of ASHRAE Standard 62.1-2007, Paragraph 5.1 (with errata but without addenda'), by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline and measure performance relative to that baseline.

The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements.

The following general topics must be addressed to demonstrate equivalency with ASHRAE Standard 62.1-2007, Paragraph 5.1 (with errata but without addenda'):

- Naturally ventilated spaces must be permanently open to the outdoors and within 25 feet (8 meters) of operable wall or roof openings.
- The openable area must be at least 4% of the net occupiable floor area. If an opening is covered with louvers or otherwise partially obstructed, calculate the openable area based on the free, unobstructed area.
- If an interior space without direct openings to the outdoors is ventilated through an adjoining room, the opening between the rooms must be permanently unobstructed and be at least 8% of the area of the interior room or 25 square feet (2 square meters).
- Whenever the space is occupied, building occupants must have a readily accessible way to control the opening.

If approved by the local authority, an engineered natural ventilation system need not meet the above requirements for location and size of openings and accessible controls.

Potential Technologies & Strategies

Design ventilation systems to meet or exceed the minimum outdoor air ventilation rates as described in the ASHRAE standard. Balance the impacts of ventilation rates on energy use and indoor air quality to optimize for energy efficiency and occupant comfort. Use the ASHRAE Standard 62.1-2007 Users Manual (with errata but without addenda') for detailed guidance on meeting the referenced requirements.

IEQ Prerequisite 2: Environmental Tobacco Smoke (ETS) Control

Required

Intent

To prevent or minimize exposure of building occupants, indoor surfaces and ventilation air distribution systems to environmental tobacco smoke (ETS).

Requirements

OPTION 1

Prohibit smoking in the building.

Prohibit on-property smoking within 25 feet (8 meters) of entries, outdoor air intakes and operable windows.

Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

OR

OPTION 2

CASE 1. Non-Residential Projects

Prohibit smoking in the building except in designated smoking areas.

Prohibit on-property smoking within 25 feet (8 meters) of entries, outdoor air intakes and operable windows.

Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

Provide designated smoking rooms designed to contain, capture and remove ETS from the building. At a minimum, the smoking room must be directly exhausted to the outdoors, away from air intakes and building entry paths, with no recirculation of ETS-containing air to nonsmoking areas and enclosed with impermeable deck-to-deck partitions. The smoking room must be operated at a negative pressure, compared with the surrounding spaces, of at least an average of 5 Pascals (Pa) (0.02 inches of water gauge) and a minimum of 1 Pa (0.004 inches of water gauge) when the doors to the smoking rooms are closed.

Verify performance of the smoking rooms' differential air pressures by conducting 15 minutes of measurement, with a minimum of 1 measurement every 10 seconds, of the differential pressure in the smoking room with respect to each adjacent area and in each adjacent vertical chase with the doors to the smoking room closed. Conduct the testing with each space configured for worst-case conditions of transport of air from the smoking rooms (with closed doors) to adjacent spaces.

CASE 2. Residential and Hospitality Projects

Prohibit smoking in all common areas of the building.

Locate any exterior designated smoking areas, including balconies where smoking is permitted, at least 25 feet (8 meters) from entries, outdoor air intakes and operable windows opening to common areas.

Prohibit on-property smoking within 25 feet (8 meters) of entries, outdoor air intakes and operable windows. Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

Weather-strip all exterior doors and operable windows in the residential units to minimize leakage from outdoors.

Minimize uncontrolled pathways for ETS transfer between individual residential units by sealing penetrations in walls, ceilings and floors in the residential units and by sealing vertical chases adjacent to the units.

Weather-strip all doors in the residential units leading to common hallways to minimize air leakage into the hallway¹.

Demonstrate acceptable sealing of residential units by a blower door test conducted in accordance with ANSI/ASTM-E779-03, Standard Test Method for Determining Air Leakage Rate By Fan Pressurization.

Use the progressive sampling methodology defined in Chapter 4 (Compliance Through Quality Construction) of the Residential Manual for Compliance with California's 2001 Energy Efficiency Standards. Residential units must demonstrate less than 1.25 square inches leakage area per 100 square feet (8 square centimeters of leakage area per 10 square meters) of enclosure area (i.e., sum of all wall, ceiling and floor areas).

OR



Alternative Compliance Path for Projects Outside the U.S.

CASE 2. Residential and Hospitality Projects

- Prohibit smoking in all common areas of the building.
- Locate any exterior designated smoking areas, including balconies where smoking is permitted, at least 25 feet (8 meters) from entries, outdoor air intakes and operable windows opening to common areas.
- Prohibit on-property smoking within 25 feet (8 meters) of entries, outdoor air intakes and operable windows.
- Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.
- Weather-strip all exterior doors and operable windows in the residential units to minimize leakage from outdoors.

¹ If the common hallways are pressurized with respect to the residential units then doors in the residential units leading to the common hallways need not be weather-stripped provided that the positive differential pressure is demonstrated as in Option 2, Case 1 above, considering the residential unit as the smoking room.

- Minimize uncontrolled pathways for ETS transfer between individual residential units by sealing penetrations in walls, ceilings and floors in the residential units and by sealing vertical chases adjacent to the units.
- Weather-strip all doors in the residential units leading to common hallways to minimize air leakage into the hallway¹.
- Demonstrate acceptable sealing of residential units by a blower door test conducted in accordance with requirements equivalent to those of ANSI/ASTM-E779-03, Standard Test Method for Determining Air Leakage Rate By Fan Pressurization. Demonstrate equivalence to the requirements of ANSI/ASTM-E779-03 by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements.
- The test method must specify a standardized technique for measuring air leakage rates through the building envelope under controlled pressurization and depressurization, not under normal conditions of weather and building operation.
- The test should be conducted with small temperature differentials and low-wind pressure conditions. Avoid testing during strong winds and large indoor-outdoor temperature differentials.
- The test method should produce a measure of the building envelope's air tightness.
- If the test method is intended to measure the air tightness of building envelopes of single-zone buildings, many multizone buildings can be treated as single-zone buildings by opening interior doors or by inducing equal pressures in adjacent zones.

Use the progressive sampling methodology defined in Chapter 4 (Compliance Through Quality Construction) of the Residential Manual for Compliance with California's 2001 Energy Efficiency Standards. Residential units must demonstrate less than 1.25 square inches leakage area per 100 square feet (8 square centimeters of leakage area per 10 square meters) of enclosure area (i.e., sum of all wall, ceiling and floor areas).

Potential Technologies & Strategies

Prohibit smoking in commercial buildings or effectively control the ventilation air in smoking rooms. For residential buildings, prohibit smoking in common areas and design building envelope and systems to minimize ETS transfer among dwelling units.

IEQ Credit 1: Outdoor Air Delivery Monitoring

1 Point

Intent

To provide capacity for ventilation system monitoring to help promote occupant comfort and well-being.

Requirements

Install permanent monitoring systems to ensure that ventilation systems maintain design minimum requirements. Configure all monitoring equipment to generate an alarm when airflow values or carbon dioxide (CO₂) levels vary by 10% or more from the design values via either a building automation system alarm to the building operator or a visual or audible alert to the building occupants

AND

CASE 1. Mechanically Ventilated Spaces

Monitor CO₂ concentrations within all densely occupied spaces i.e., those with a design occupant density of 25 people or more per 1,000 square feet (95 square meters). CO₂ monitors must be between 3 and 6 feet (between 1 and 2 meters) above the floor.

Provide a direct outdoor airflow measurement device capable of measuring the minimum outdoor air intake flow with an accuracy of plus or minus 15% of the design minimum outdoor air rate, as defined by ASHRAE 62.1-2007 (with errata but without addenda¹) for mechanical ventilation systems where 20% or more of the design supply airflow serves nondensely occupied spaces.

CASE 2. Naturally Ventilated Spaces

Monitor CO₂ concentrations within all naturally ventilated spaces. CO₂ monitors must be between 3 and 6 feet (between 1 and 2 meters) above the floor. One CO₂ sensor may be used to monitor multiple nondensely occupied spaces if the natural ventilation design uses passive stack(s) or other means to induce airflow through those spaces equally and simultaneously without intervention by building occupants.

OR



Alternative Compliance Path for Projects Outside the U.S.

Install permanent monitoring systems to ensure that ventilation systems maintain design minimum requirements. Configure all monitoring equipment to generate an alarm when airflow values or carbon dioxide (CO₂) levels vary by 10% or more from the design values via either a building automation system alarm to the building operator or a visual or audible alert to the building occupants.

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

AND

CASE 1. Mechanically Ventilated Spaces

OPTION 1

Monitor CO₂ concentrations within all densely occupied spaces—i.e., those with a design occupant density of 25 people or more per 1,000 square feet (95 square meters). CO₂ monitors must be between 3 and 6 feet (between 1 and 2 meters) above the floor.

Provide a direct outdoor airflow measurement device capable of measuring the minimum outdoor air intake flow with an accuracy of plus or minus 15% of the design minimum outdoor air rate, as defined by Comité Européen de Normalisation (CEN) Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics, and CEN Standard EN 13779, Ventilation for non residential buildings, Performance requirements for ventilation and room conditioning systems, for mechanical ventilation systems where 20% or more of the design supply airflow serves nondensely occupied spaces.

OR

OPTION 2

Monitor CO₂ concentrations within all densely occupied spaces—i.e., those with a design occupant density of 25 people or more per 1,000 square feet (95 square meters). CO₂ monitors must be between 3 and 6 feet (between 1 and 2 meters) above the floor.

Provide a direct outdoor airflow measurement device capable of measuring the minimum outdoor air intake flow with an accuracy of plus or minus 15% of the design minimum outdoor air rate, as defined by a local equivalent standard. Demonstrate performance that is equivalent to the requirements of ASHRAE Standard 62.1–2007 (with errata but without addenda¹), by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements.

The following general topics must be addressed to demonstrate equivalency with the design minimum outdoor air rate requirements of ASHRAE 62.1-2007 (with errata but without addenda¹):

- Ventilation rate procedure
- Indoor air quality (IAQ) procedure
- Design documentation procedures

CASE 2. Naturally Ventilated Spaces

Monitor CO₂ concentrations within all naturally ventilated spaces. CO₂ monitors must be between 3 and 6 feet (between 1 and 2 meters) above the floor. One CO₂ sensor may be used to monitor multiple nondensely occupied spaces if the natural ventilation design uses passive stack(s) or other means to induce airflow through those spaces equally and simultaneously without intervention by building occupants².

Potential Technologies & Strategies

Install CO₂ and airflow measurement equipment and feed the information to the heating, ventilating and air conditioning (HVAC) system and/or building automation system (BAS) to trigger corrective action, if applicable. If such automatic controls are not feasible with the building systems, use the measurement equipment to trigger alarms that inform building operators or occupants of a possible deficiency in outdoor air delivery.

IEQ Credit 2: Increased Ventilation

1 Point

Intent

To provide additional outdoor air ventilation to improve indoor air quality (IAQ) and promote occupant comfort, well-being and productivity.

Requirements

CASE 1. Mechanically Ventilated Spaces

Increase breathing zone outdoor air ventilation rates to all occupied spaces by at least 30% above the minimum rates required by ASHRAE Standard 62.1-2007 (with errata but without addenda¹) as determined by IEQ

Prerequisite 1: Minimum Indoor Air Quality Performance.

CASE 2. Naturally Ventilated Spaces

Determine that natural ventilation is an effective strategy for the project by following the flow diagram process shown in Figure 2.8 of the CIBSE Applications Manual 10: 2005, Natural Ventilation in Non-domestic Buildings.

AND

OPTION 1

Show that the natural ventilation systems design meets the recommendations set forth in the CIBSE manuals appropriate to the project space.

PATH 1. CIBSE Applications Manual 10: 2005, Natural Ventilation in Non-domestic Buildings

PATH 2. CIBSE AM 13:2000, Mixed Mode Ventilation

OR

OPTION 2

Use a macroscopic, multizone, analytic model to predict that room-by-room airflows will effectively naturally ventilate, defined as providing the minimum ventilation rates required by ASHRAE 62.1-2007 Chapter 6 (with errata but without addenda¹), for at least 90% of occupied spaces.

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

OR



Alternative Compliance Path for Projects Outside the U.S.

CASE 1. Mechanically Ventilated Spaces

OPTION 1

Increase breathing zone outdoor air ventilation rates to all occupied spaces by at least 30% above the minimum rates required by Annex B and the requirements of Appendix B of Comité Européen de Normalisation (CEN) Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics; and the requirements of CEN Standard EN 13779, Ventilation for non residential buildings, Performance requirements for ventilation and room conditioning systems, as determined by IEQ Prerequisite 1: Minimum Indoor Air Quality Performance,

OR

OPTION 2

Increase breathing zone outdoor air ventilation rates to all occupied spaces by at least 30% above the minimum rates required by a local standard equivalent to ASHRAE Standard 62.1-2007 (with errata but without addenda¹) by substituting appropriate benchmarks and metrics. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements. The following general topics must be addressed to demonstrate equivalency with ASHRAE 62.1-2007 (with errata but without addenda¹):

- Outdoor air quality
- Systems and equipment
- Ventilation rate procedure and indoor air quality IAQ (indoor air quality) procedure
- Construction and system start-up

CASE 2. Naturally Ventilated Spaces

Show that the natural ventilation systems design meets the recommendations set forth in the local standard equivalent to CIBSE. Demonstrate performance that is equivalent to the requirements of the flow diagram process shown in the CIBSE Applications Manual 10: 2005, Natural Ventilation in Non-domestic Buildings, Figure 2.8, by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements.

The following general topics must be addressed to demonstrate equivalency with Figure 2.8 of CIBSE AM 10:2005:

- Heat gain
- Transient occupancy
- Seasonal mixed-mode ventilation
- Floor plan
- Courtyard or atrium layout

- Zonal mixed-mode ventilation
- Perimeter zone conditions, including noise and pollution levels
- Control of ventilation by occupants
- Temperature and relative humidity control
- Humidification

AND

OPTION 1

Demonstrate performance that is equivalent to the requirements of CIBSE Applications Manual 10: 2005 or CIBSE AM 13: 2000, Mixed Mode Ventilation, by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements.

PATH 1. Natural Ventilation in Nondomestic Buildings

The following general topics must be addressed to demonstrate equivalency with CIBSE AM 10: 2005:

Design Strategy

- Design
- Selection process for natural ventilation
- Wind and stack effects
- Natural ventilation strategies (e.g., chimney ventilation, stack ventilation)

Ventilation Components and System Integration

- Principles, products and processes for ventilation and control
- Ventilation opening types
- Internal obstructions
- Background leakage
- Window stays and automatic actuators
- Control system
- Installation and commissioning

Design Calculations

- Required flow rates
- Ventilation design tool selection
- Design procedures using envelope flow models
- Input data requirements and selection
- Reservoir effect

PATH 2. Mixed-Mode Ventilation

The following general topics must be addressed to demonstrate equivalency with CIBSE AM 13: 2000:

- Mixed mode ventilation types
- Design principles for mixed mode buildings and systems
- Building fabric properties
- Contingency mixed mode
- Complementary mixed mode
- Zoned mixed-mode systems
- Control of mixed-mode systems
- Commissioning considerations for the designer
- Handover, management and operation considerations for the designer
- Modeling and modeling techniques
- Energy and environmental benefits
- Window design
- Thermal comfort
- Commissioning activities
- Handover, management, operation and maintenance considerations

OR

OPTION 2

Demonstrate minimum ventilation rate performance equivalent to the requirements of ASHRAE 62.1–2007, Chapter 6 (with errata but without addenda¹), for at least 90% of occupied spaces, by substituting appropriate benchmarks and metrics that use a local standard for establishing a baseline, and measure performance relative to that baseline. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements. The following general topics must be addressed to demonstrate equivalency with ASHRAE 62.1–2007, Chapter 6 (with errata but without addenda¹):

- Ventilation rate procedure
- Indoor air quality (IAQ) procedure
- Design documentation procedures

Potential Technologies & Strategies

For mechanically ventilated spaces: Use heat recovery, where appropriate, to minimize the additional energy consumption associated with higher ventilation rates.

For naturally ventilated spaces, follow the 8 design steps described in the Carbon Trust Good Practice Guide 237:

- Develop design requirements.
- Plan airflow paths.
- Identify building uses and features that might require special attention.
- Determine ventilation requirements.
- Estimate external driving pressures.
- Select types of ventilation devices.
- Size ventilation devices.
- Analyze the design.

Use public domain software such as NIST's CONTAM, Multizone Modeling Software, along with LoopDA, Natural Ventilation Sizing Tool, to analytically predict room-by-room airflows.

IEQ Credit 3.1: Construction Indoor Air Quality Management Plan—During Construction

1 Point

Intent

To reduce indoor air quality (IAQ) problems resulting from construction or renovation and promote the comfort and well-being of construction workers and building occupants.

Requirements

Develop and implement an IAQ management plan for the construction and preoccupancy phases of the building as follows:

- During construction, meet or exceed the recommended control measures of the Sheet Metal and Air Conditioning National Contractors Association (SMACNA) IAQ Guidelines For Occupied Buildings Under Construction, 2nd Edition 2007, ANSI/SMACNA 008-2008 (Chapter 3).
- Protect stored on-site and installed absorptive materials from moisture damage.
- If permanently installed air handlers are used during construction, filtration media with a minimum efficiency reporting value (MERV) of 8 must be used at each return air grille, as determined by ASHRAE Standard 52.2-1999 (with errata but without addenda¹). Replace all filtration media immediately prior to occupancy.

OR



Alternative Compliance Path for Projects Outside the U.S.

Develop and implement an IAQ management plan for the construction and preoccupancy phases of the building as follows:

- During construction, addresses the following project-specific issues:

HVAC Protection

- a. Avoid using permanently installed HVAC systems if possible. Use temporary systems where possible.
- b. If permanently installed air handlers are used during construction, filtration media must be used at each return air grille. Filtration must have a minimum efficiency of 30% or an arrestance of greater than 90%. Replace all filtration media immediately prior to occupancy.
- c. Store equipment in a clean, dry location. Protect ducts and equipment by sealing openings with plastic.
- d. Clean air plenums before use.

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

Source Control

- a. Avoid finish materials with high VOC and formaldehyde levels.
- b. Recover, isolate and ventilate as appropriate when using any toxic materials or creating exhaust fumes.
- c. Protect stored on-site and installed absorptive materials from moisture damage. Do not install moisture-damaged materials unless they have been properly dried.
- d. Implement measures to avoid the tracking of pollutants into work area and occupied portions of the building.

Pathway Interruption

- a. Isolate areas to prevent contamination of clean or occupied spaces using physical separation and depressurization.

Housekeeping

- a. Implement practices to ensure a clean job site to control potential contaminants such as dirt, dust and debris.
- b. Clean up spills, and keep work areas dry.

Scheduling

- a. Coordinate construction activities to minimize disruption of occupied spaces.
 - b. Carefully sequence construction activities to minimize IAQ issues.
- Protect stored on-site and installed absorptive materials from moisture damage.
 - If permanently installed air handlers are used during construction, one of the following filtration media must be used at each return air grille. Replace all filtration media immediately prior to occupancy.
 - a. Filtration media with a minimum efficiency reporting value (MERV) of 8 or higher, as determined by ASHRAE Standard 52.2-1999 (with errata but without addenda).
 - b. Equivalent filtration media Class F5 or higher, as defined by CEN Standard EN 779-2002, Particulate air filters for general ventilation, Determination of the filtration performance.
 - c. Equivalent filtration media with a minimum duct spot efficiency of 30% or higher and greater than 90% arrestance on a particle size of 3-10 µg.

Potential Technologies & Strategies

Adopt an IAQ management plan to protect the heating, ventilating and air conditioning (HVAC) system during construction, control pollutant sources and interrupt contamination pathways. Sequence the installation of materials to avoid contamination of absorptive materials, such as insulation, carpeting, ceiling tile and gypsum wallboard. Coordinate with IEQ Credit 3.2: Construction IAQ Management Plan—Before Occupancy and IEQ Credit 5: Indoor Chemical & Pollutant Source Control to determine the appropriate specifications and schedules for filtration media.

If possible, avoid using permanently installed air handlers for temporary heating/cooling during construction. Consult the LEED Reference Guide for Green Building Design and Construction, 2009 Edition for more detailed information on how to ensure the well-being of construction workers and building occupants if permanently installed air handlers must be used during construction.

IEQ Credit 3.2: Construction Indoor Air Quality Management Plan—Before Occupancy

1 Point

Intent

To reduce indoor air quality (IAQ) problems resulting from construction or renovation to promote the comfort and well-being of construction workers and building occupants.

Requirements

Develop an IAQ management plan and implement it after all finishes have been installed and the building has been completely cleaned before occupancy.

OPTION 1. Flush-Out¹

PATH 1

After construction ends, prior to occupancy and with all interior finishes installed, install new filtration media and , perform a building flush-out by supplying a total air volume of 14,000 cubic feet of outdoor air per square foot (4,500 cubic meters of outdoor air per square meter) of floor area while maintaining an internal temperature of at least 60° F (15°C) and relative humidity no higher than 60%.

OR

PATH 2

If occupancy is desired prior to completion of the flush-out, the space may be occupied following delivery of a minimum of 3,500 cubic feet of outdoor air per square foot (1,000 cubic meters of outdoor air per square meter) of floor area. Once the space is occupied, it must be ventilated at a minimum rate of 0.30 cubic feet per minute (cfm) per square foot (0.1 cubic meters of outside air per minute per square meter) of outside air or the design minimum outside air rate determined in IEQ Prerequisite 1: Minimum Indoor Air Quality Performance, whichever is greater. During each day of the flush-out period, ventilation must begin a minimum of 3 hours prior to occupancy and continue during occupancy. These conditions must be maintained until a total of 14,000 cubic feet per square foot (4,500 cubic meters of outside air per square meter) of outside air has been delivered to the space.

OR

OPTION 2. Air Testing

Conduct baseline IAQ testing after construction ends and prior to occupancy using testing protocols consistent with the EPA Compendium of Methods for the Determination of Air Pollutants in Indoor Air or the ISO method listed in the table below. Testing must be done in accordance with one standard; project teams may not mix requirements from the EPA Compendium of Methods with ISO.

¹ All finishes must be installed prior to flush-out.

Demonstrate that the contaminant maximum concentration levels listed below are not exceeded:

Contaminant	Maximum Concentration	EPA Compendium method	ISO method
Formaldehyde	27 parts per billion	IP-6	ISO 16000-3
Particulates (PM10)	50 micrograms per cubic meter	IP-10	ISO 7708
Total volatile organic compounds (TVOCs)	500 micrograms per cubic meter	IP-1	ISO 16000-6
4-Phenylcyclohexene (4-PCH)*	6.5 micrograms per cubic meter	IP-1	ISO 16000-6
Carbon monoxide (CO)	9 part per million and no greater than 2 parts per million above outdoor levels	IP-3	ISO 4224

* This test is only required if carpets and fabrics with styrene butadiene rubber (SBR) latex backing are installed as part of the base building systems.

For each sampling point where the maximum concentration limits are exceeded, conduct an additional flush-out with outside air and retest the noncompliant concentrations. Repeat until all requirements are met. When retesting noncompliant building areas, take samples from the same locations as in the first test, although it is not required.

Conduct the air sample testing as follows:

- All measurements must be conducted prior to occupancy, but during normal occupied hours with the building ventilation system started at the normal daily start time and operated at the minimum outside air flow rate for the occupied mode throughout the test.
- All interior finishes must be installed, including but not limited to millwork, doors, paint, carpet and acoustic tiles. Movable furnishings such as workstations and partitions should be in place for the testing, although it is not required.
- The number of sampling locations will depend on the size of the building and number of ventilation systems. The number of sampling locations must include the entire building and all representative situations. Include areas with the least ventilation and greatest presumed source strength.
- Air samples must be collected between 3 and 6 feet (between 1 and 2 meters) from the floor to represent the breathing zone of occupants, and over a minimum 4-hour period.

Potential Technologies & Strategies

Prior to occupancy, perform a building flush-out or test the air contaminant levels in the building. The flush-out is often used where occupancy is not required immediately upon substantial completion of construction. IAQ testing can minimize schedule impacts but may be more costly. Coordinate with IEQ Credit 3.1: Construction IAQ Management Plan—During Construction and IEQ Credit 5: Indoor Chemical & Pollutant Source Control to determine the appropriate specifications and schedules for filtration media.

The intent of this credit is to eliminate IAQ problems that occur as a result of construction. Architectural finishes used in tenant build-outs constitute a significant source of air pollutants and must be addressed to qualify for this credit.

IEQ Credit 4.1: Low-Emitting Materials—Adhesives and Sealants

1 Point

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

All adhesives and sealants used on the interior of the building (i.e., inside of the weatherproofing system and applied on-site) must comply with the following requirements as applicable to the project scope¹:

- Adhesives, Sealants and Sealant Primers must comply with South Coast Air Quality Management District (SCAQMD) Rule #1168. Volatile organic compound (VOC) limits listed in the table below correspond to an effective date of July 1, 2005 and rule amendment date of January 7, 2005.

Architectural Applications	VOC Limit (g/L less water)	Specialty Applications	VOC Limit (g/L less water)
Indoor carpet adhesives	50	PVC welding	510
Carpet pad adhesives	50	CPVC welding	490
Wood flooring adhesives	100	ABS welding	325
Rubber floor adhesives	60	Plastic cement welding	250
Subfloor adhesives	50	Adhesive primer for plastic	550
Ceramic tile adhesives	65	Contact adhesive	80
VCT and asphalt adhesives	50	Special purpose contact adhesive	250
Drywall and panel adhesives	50	Structural wood member adhesive	140
Cove base adhesives	50	Sheet applied rubber lining operations	850
Multipurpose construction adhesives	70	Top and trim adhesive	250
Structural glazing adhesives	100		
Substrate Specific Applications	VOC Limit (g/L less water)	Sealants	VOC Limit (g/L less water)
Metal to metal	30	Architectural	250
Plastic foams	50	Roadway	250
Porous material (except wood)	50	Other	420
Wood	30		
Fiberglass	80		
Sealant Primers	VOC Limit (g/L less water)		
Architectural, nonporous	250		
Architectural, porous	775		
Other	750		

¹ The use of a VOC budget is permissible for compliance with this credit.

-
- Aerosol Adhesives must comply with Green Seal Standard for Commercial Adhesives GS-36 requirements in effect on October 19, 2000.

Aerosol Adhesives	VOC Limit
General purpose mist spray	65% VOCs by weight
General purpose web spray	55% VOCs by weight
Special purpose aerosol adhesives (all types)	70% VOCs by weight

This table excludes adhesives and sealants integral to the water-proofing system or that are not building related.

Potential Technologies & Strategies

Specify low-VOC materials in construction documents. Ensure that VOC limits are clearly stated in each section of the specifications where adhesives and sealants are addressed. Common products to evaluate include general construction adhesives, flooring adhesives, fire-stopping sealants, caulking, duct sealants, plumbing adhesives and cove base adhesives. Review product cut sheets, material safety data (MSD) sheets, signed attestations or other official literature from the manufacturer clearly identifying the VOC contents or compliance with referenced standards.

IEQ Credit 4.2: Low-Emitting Materials—Paints and Coatings

1 Point

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

Paints and coatings used on the interior of the building (i.e., inside of the weatherproofing system and applied on-site) must comply with the following criteria as applicable to the project scope¹:

- Architectural paints and coatings applied to interior walls and ceilings must not exceed the volatile organic compound (VOC) content limits established in Green Seal Standard GS-11, Paints, 1st Edition, May 20, 1993.
- Anti-corrosive and anti-rust paints applied to interior ferrous metal substrates must not exceed the VOC content limit of 250 g/L (2 lb/gal) established in Green Seal Standard GC-03, Anti-Corrosive Paints, 2nd Edition, January 7, 1997.
- Clear wood finishes, floor coatings, stains, primers, sealers, and shellacs applied to interior elements must not exceed the VOC content limits established in South Coast Air Quality Management District (SCAQMD) Rule 1113, Architectural Coatings, rules in effect on January 1, 2004.

Potential Technologies & Strategies

Specify low-VOC paints and coatings in construction documents. Ensure that VOC limits are clearly stated in each section of the specifications where paints and coatings are addressed. Track the VOC content of all interior paints and coatings during construction.

¹ The use of a VOC budget is permissible for compliance with this credit.

IEQ Credit 4.3: Low-Emitting Materials—Flooring Systems

1 Point

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

OPTION 1

All flooring must comply with the following as applicable to the project scope:

- All carpet installed in the building interior must meet the testing and product requirements of the Carpet and Rug Institute Green Label Plus¹ program.
- All carpet cushion installed in the building interior must meet the requirements of the Carpet and Rug Institute Green Label program.
- All carpet adhesive must meet the requirements of IEQ Credit 4.1: Adhesives and Sealants, which includes a volatile organic compound (VOC) limit of 50 g/L (0.4 lb/gal).
- All hard surface flooring must meet the requirements of the FloorScore² standard (current as of the date of this rating system, or more stringent version) as shown with testing by an independent third-party. Mineral-based finish flooring products such as tile, masonry, terrazzo, and cut stone without integral organic-based coatings and sealants and unfinished/untreated solid wood flooring qualify for credit without any IAQ testing requirements. However, associated site-applied adhesives, grouts, finishes and sealers must be compliant for a mineral-based or unfinished/untreated solid wood flooring system to qualify for credit.
- Concrete, wood, bamboo and cork floor finishes such as sealer, stain and finish must meet the requirements of South Coast Air Quality Management District (SCAQMD) Rule 1113, Architectural Coatings, rules in effect on January 1, 2004.
- Tile setting adhesives and grout must meet South Coast Air Quality Management District (SCAQMD) Rule 1168. VOC limits correspond to an effective date of July 1, 2005 and rule amendment date of January 7, 2005.

OR

OPTION 2

All flooring elements installed in the building interior must meet the testing and product requirements of the California Department of Health Services Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers, including 2004 Addenda.

- 1 The Green Label Plus program for carpets and its associated VOC emission criteria in micrograms per square meter per hour, along with information on testing method and sample collection developed by the Carpet & Rug Institute (CRI) in coordination with California's Sustainable Building Task Force and the California Department of Public Health, are described in Section 9, Acceptable Emissions Testing for Carpet, DHS Standard Practice CA/DHS/EHLB/R-174, dated 07/15/04. This document is available at http://www.dhs.ca.gov/ps/deodc/ehlb/iaq/VOCS/Section01350_7_15_2004_FINAL_PLUS_ADDENDUM-2004-01.pdf (also published as Section 01350 Section 9 [dated 2004] by the Collaborative for High Performance Schools [<http://www.chps.net>]).
- 2 FloorScore is a voluntary, independent certification program that tests and certifies hard surface flooring and associated products for compliance with criteria adopted in California for indoor air emissions of VOCs with potential health effects. The program uses a small-scale chamber test protocol and incorporates VOC emissions criteria, which are widely known as Section 1350, developed by the California Department of Health Services.

Mineral-based finish flooring products such as tile, masonry, terrazzo, and cut stone without integral organic-based coatings and sealants and unfinished/untreated solid wood flooring qualify for credit without any IAQ testing requirements. However, associated site-applied adhesives, grouts, finishes and sealers must be compliant for a mineral-based or unfinished/untreated solid wood flooring system to qualify for credit.

OR



Alternative Compliance Path for Projects Outside the U.S.

OPTION 1

All flooring must comply with the following as applicable to the project scope:

- All carpet installed in the building interior must demonstrate equivalence to the emissions test criteria of the CRI Green Label Plus Carpet Program (<http://www.carpet-rug.org/commercial-customers/green-building-and-the-environment/green-label-plus/carpet-and-adhesive.cfm> or http://www.carpet-rug.org/pdf_word_docs/071028_Carpet_GLP_Criteria.pdf) using the ICC Evaluation Service (ICC-ES) Evaluation Guideline for Determination of Volatile Organic Compound (VOC) Content and Emissions of Floor Covering Products, EG107, as a testing protocol (<http://saveprogram.icc-es.org/guidelines/pdf/EG107.pdf>). For more information, see the Reference Guide, Figure 1, Sample Product Information for CRI Green Label Plus Carpeting.
- All carpet cushion installed in the building interior must demonstrate maximum emissions factors less than stated below (from <http://www.carpet-rug.org/commercial-customers/green-building-and-the-environment/green-label-plus/cushion.cfm>). The testing protocol must follow the ICC Evaluation Service (ICC-ES) Evaluation Guideline for Determination of Volatile Organic Compound (VOC) Content and Emissions of Floor Covering Products, EG107 (<http://saveprogram.icc-es.org/guidelines/pdf/EG107.pdf>).

	Maximum Allowance
TVOCs	1000 µg/m ² per hour
BHT	300 µg/m ² per hour
Formaldehyde	50 µg/m ² per hour
4-PCH	50 µg/m ² per hour

- All carpet adhesive must meet the requirements of IEQ Credit 4.1: Adhesives and Sealants, which includes a volatile organic compound (VOC) limit of 50 g/L (0.4 lb/gal).
- All hard surface flooring must demonstrate maximum emissions factors less than or equal to those stated below, as shown with testing by an independent third party. Mineral-based finish flooring products such as tile, masonry, terrazzo, and cut stone without integral organic-based coatings and sealants and unfinished/untreated solid wood flooring qualify for credit without any IAQ testing requirements. However, associated site-applied adhesives, grouts, finishes and sealers must be compliant for a mineral-based or unfinished/untreated solid wood flooring system to qualify for credit. The testing protocol to determine the emissions factors must follow the ICC Evaluation Service (ICC-ES) Evaluation Guideline for Determination of Volatile Organic Compound (VOC) Content and Emissions of Floor Covering Products, EG107 (<http://www.saveprogram.icc-es.org/guidelines/pdf/EG107.pdf>).
 - a. Formaldehyde, 1.65 µg/m³ per hour
 - b. Acetaldehyde, 9 µg/m³ per hour

c. All other organic chemicals with established Chronic Reference Exposure Levels (CRELs) less than or equal to 1/2 CREL as listed in the latest edition of the Cal/EPA OEHHA list of chemicals with noncancer CRELs (http://www.oehha.ca.gov/air/chronic_rels/AllChrels.html).

- Concrete, wood, bamboo and cork floor finishes such as sealer, stain and finish must not exceed the VOC limits listed in IEQ Credit 4.2: Paints and Coatings.
- Tile setting adhesives and grout must not exceed the VOC limits listed in IEQ Credit 4.1: Adhesives and Sealants.

Potential Technologies & Strategies

Clearly specify requirements for product testing and/or certification in the construction documents. Select products that are either certified under the Green Label Plus program or for which testing has been done by qualified independent laboratories in accordance with the appropriate requirements.

IEQ Credit 4.4: Low-Emitting Materials—Composite Wood and Agrifiber Products

1 Point

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

Composite wood and agrifiber products used on the interior of the building (i.e., inside the weatherproofing system) must contain no added urea-formaldehyde resins. Laminating adhesives used to fabricate on-site and shop-applied composite wood and agrifiber assemblies must not contain added urea-formaldehyde resins.

Composite wood and agrifiber products are defined as particleboard, medium density fiberboard (MDF), plywood, wheatboard, strawboard, panel substrates and door cores. Materials considered fixtures, furniture and equipment (FF&E) are not considered base building elements and are not included.

Potential Technologies & Strategies

Specify wood and agrifiber products that contain no added urea-formaldehyde resins. Specify laminating adhesives for field and shop-applied assemblies that contain no added urea-formaldehyde resins. Review product cut sheets, material safety data (MSD) sheets, signed attestations or other official literature from the manufacturer.

IEQ Credit 5: Indoor Chemical and Pollutant Source Control

1 Point

Intent

To minimize building occupant exposure to potentially hazardous particulates and chemical pollutants.

Requirements

Design to minimize and control the entry of pollutants into buildings and later cross-contamination of regularly occupied areas through the following strategies:

- Employ permanent entryway systems at least 10 feet (3 meters) long in the primary direction of travel to capture dirt and particulates entering the building at regularly used exterior entrances. Acceptable entryway systems include permanently installed grates, grills and slotted systems that allow for cleaning underneath. Roll-out mats are acceptable only when maintained on a weekly basis by a contracted service organization.
- Sufficiently exhaust each space where hazardous gases or chemicals may be present or used (e.g., garages, housekeeping and laundry areas, copying and printing rooms) to create negative pressure with respect to adjacent spaces when the doors to the room are closed. For each of these spaces, provide self-closing doors and deck-to-deck partitions or a hard-lid ceiling. The exhaust rate must be at least 0.50 cubic feet per minute (cfm) per square foot (0.15 cubic meters per minute per square meter) with no air recirculation. The pressure differential with the surrounding spaces must be at least 5 Pascals (Pa) (0.02 inches of water gauge) on average and 1 Pa (0.004 inches of water) at a minimum when the doors to the rooms are closed.
- In mechanically ventilated buildings, each ventilation system that supplies outdoor air shall comply with the following:
 - Particle filters or air cleaning devices shall be provided to clean the outdoor air at any location prior to its introduction to occupied spaces.
 - These filters or devices shall be rated a minimum efficiency reporting value (MERV) of 13 or higher in accordance with ASHRAE Standard 52.2.
 - Clean air filtration media shall be installed in all air systems after completion of construction and prior to occupancy.

OR



Alternative Compliance Path for Projects Outside the U.S.

- In mechanically ventilated buildings, install new air filtration media in regularly occupied areas prior to occupancy; filtration should be applied to process both return and outside air that is delivered as supply air. Use one of the following filtration media:
 - a. Filtration media with a minimum efficiency reporting value (MERV) of 13 or higher, as determined by ASHRAE Standard 52.2-1999 (with errata but without addenda).
 - b. Equivalent filtration media Class F7 or higher, as defined by CEN Standard EN 779-2002, Particulate air filters for general ventilation, Determination of the filtration performance.
 - c. Equivalent filtration media with a minimum duct spot efficiency of 80% or higher and greater than 98% arrestance on a particle size of 3-10 µg.

Potential Technologies & Strategies

Design facility cleaning and maintenance areas with isolated exhaust systems for contaminants. Maintain physical isolation from the rest of the regularly occupied areas of the building. Install permanent architectural entryway systems such as grills or grates to prevent occupant-borne contaminants from entering the building. Install high-level filtration systems in air handling units processing outside supply air. Ensure that air handling units can accommodate required filter sizes and pressure drops.

IEQ Credit 6.1: Controllability of Systems—Lighting

1 Point

Intent

To provide a high level of lighting system control by individual occupants or groups in multi-occupant spaces (e.g., classrooms and conference areas) and promote their productivity, comfort and well-being.

Requirements

Provide individual lighting controls for 90% (minimum) of the building occupants to enable adjustments to suit individual task needs and preferences

Provide lighting system controls for all shared multi-occupant spaces to enable adjustments that meet group needs and preferences.

Potential Technologies & Strategies

Design the building with occupant controls for lighting. Strategies to consider include lighting controls and task lighting. Integrate lighting systems controllability into the overall lighting design, providing ambient and task lighting while managing the overall energy use of the building.

IEQ Credit 6.2: Controllability of Systems—Thermal Comfort

1 Point

Intent

To provide a high level of thermal comfort system control¹ by individual occupants or groups in multi-occupant spaces (e.g., classrooms or conference areas) and promote their productivity, comfort and well-being.

Requirements

Provide individual comfort controls for 50% (minimum) of the building occupants to enable adjustments to meet individual needs and preferences. Operable windows may be used in lieu of controls for occupants located 20 feet (6 meters) inside and 10 feet (3 meters) to either side of the operable part of a window. The areas of operable window must meet the requirements of ASHRAE Standard 62.1-2007 paragraph 5.1 Natural Ventilation (with errata but without addenda²).

Provide comfort system controls for all shared multi-occupant spaces to enable adjustments that meet group needs and preferences.

Conditions for thermal comfort are described in ASHRAE Standard 55-2004 (with errata but without addenda²) and include the primary factors of air temperature, radiant temperature, air speed and humidity.

OR

Alternative Compliance Path for Projects Outside the U.S.

OPTION 1

Provide individual comfort controls for 50% (minimum) of the building occupants to enable adjustments to meet individual needs and preferences. Operable windows may be used in lieu of controls for occupants located 20 feet (6 meters) inside and 10 feet (3 meters) to either side of the operable part of a window. The areas of operable window must meet the requirements of Comité Européen de Normalisation (CEN) Standard EN15251 Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics.

Provide comfort system controls for all shared multioccupant spaces to enable adjustments that meet group needs and preferences.

Conditions for thermal comfort are described in Comité Européen de Normalisation (CEN) Standard EN15251, include the primary factors of air temperature, radiant temperature, air speed and humidity.

OR

OPTION 2

Provide individual comfort controls for 50% (minimum) of the building occupants to enable adjustments to meet individual needs and preferences. Operable windows may be used in lieu of controls for occupants

¹ For the purposes of this credit, comfort system control is defined as control over at least 1 of the following primary factors in the occupant's vicinity: air temperature, radiant temperature, air speed and humidity.

² Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.



located 20 feet (6 meters) inside and 10 feet (3 meters) to either side of the operable part of a window. The areas of operable window must meet the following requirements:

- The operable area must be at least 4% of the net occupiable floor area. If an opening is covered with louvers or otherwise partially obstructed, calculate the operable area based on the free, unobstructed area.
- If an interior space without direct openings to the outdoors is ventilated through an adjoining room, the opening between the rooms must be permanently unobstructed and be at least 8% of the area of the interior room or 25 square feet (2 square meters).
- Whenever the space is occupied, building occupants must have a readily accessible way to control the opening.

Provide comfort system controls for all shared multioccupant spaces to enable adjustments that meet group needs and preferences.

Conditions for thermal comfort are described in International Organization for Standardization (ISO) 7730, Ergonomics of the thermal environment, Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria, and CEN Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics.

OR

OPTION 3

Provide individual comfort controls for 50% (minimum) of the building occupants to enable adjustments to meet individual needs and preferences. Operable windows may be used in lieu of controls for occupants located 20 feet (6 meters) inside and 10 feet (3 meters) to either side of the operable part of a window. The areas of operable window must meet the requirements of a local standard equivalent to ASHRAE 55-2004.

Provide comfort system controls for all shared multioccupant spaces to enable adjustments that meet group needs and preferences. Conditions for thermal comfort are described in ASHRAE Standard 55-2004 (with errata but without addenda³) and include the primary factors of air temperature, radiant temperature, air speed and humidity.

Potential Technologies & Strategies

Design the building and systems with comfort controls to allow adjustments to suit individual needs or those of groups in shared spaces. ASHRAE Standard 55-2004 (with errata but without addenda³) identifies the factors of thermal comfort and a process for developing comfort criteria for building spaces that suit the needs of the occupants involved in their daily activities. Control strategies can be developed to expand on the comfort criteria and enable individuals to make adjustments to suit their needs and preferences. These strategies may involve system designs incorporating operable windows, hybrid systems integrating operable windows and mechanical systems, or mechanical systems alone. Individual adjustments may involve individual thermostat controls, local diffusers at floor, desk or overhead levels, control of individual radiant panels or other means integrated into the overall building, thermal comfort systems and energy systems design. Designers should evaluate the closely tied interactions between thermal comfort as required by ASHRAE Standard 55-2004 (with errata but without addenda³) and acceptable indoor air quality as required by ASHRAE Standard 62.1-2007 (with errata but without addenda³), whether natural or mechanical ventilation.

³ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

IEQ Credit 7.1: Thermal Comfort—Design

1 Point

Intent

To provide a comfortable thermal environment that promotes occupant productivity and well-being.

Requirements

Design heating, ventilating and air conditioning (HVAC) systems and the building envelope to meet the requirements of ASHRAE Standard 55-2004, Thermal Comfort Conditions for Human Occupancy (with errata but without addenda¹). Demonstrate design compliance in accordance with the Section 6.1.1 documentation.

OR

Alternative Compliance Path for Projects Outside the U.S.

OPTION 1

Design heating, ventilating and air conditioning (HVAC) systems and the building envelope to meet the requirements of International Organization for Standardization (ISO) 7730 Ergonomics of the thermal environment, Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria; and CEN Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics.

OR

OPTION 2

Design heating, ventilating and air conditioning (HVAC) systems and the building envelope to meet the requirements of a local standard that is equivalent to ASHRAE Standard 55-2004 by substituting appropriate benchmarks and metrics. The following guidelines outline the methodology for establishing acceptable benchmarks and metrics pertaining to this credit's requirements:

- Address any adjustments to thermal comfort parameters described by ASHRAE 55-2004.
- Demonstrate design compliance in accordance with the documentation described in ASHRAE Standard 55-2004, Section 6.1.1.

Potential Technologies & Strategies

Establish comfort criteria according to ASHRAE 55-2004 (with errata but without addenda) that support the desired quality and occupant satisfaction with building performance. Design the building envelope and systems with the capability to meet the comfort criteria under expected environmental and use conditions. Evaluate air temperature, radiant temperature, air speed and relative humidity in an integrated fashion, and coordinate these criteria with IEQ Prerequisite 1: Minimum IAQ Performance, IEQ Credit 1: Outdoor Air Delivery Monitoring, and IEQ Credit 2: Increased Ventilation.

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

IEQ Credit 7.2: Thermal Comfort—Verification

1 point in addition to IEQ credit 7.1

Intent

To provide for the assessment of building occupant thermal comfort over time.

Requirements

Achieve IEQ Credit 7.1: Thermal Comfort—Design

Provide a permanent monitoring system to ensure that building performance meets the desired comfort criteria as determined by IEQ Credit 7.1: Thermal Comfort—Design.

Agree to conduct a thermal comfort survey of building occupants within 6 to 18 months after occupancy. This survey should collect anonymous responses about thermal comfort in the building, including an assessment of overall satisfaction with thermal performance and identification of thermal comfort-related problems. Agree to develop a plan for corrective action if the survey results indicate that more than 20% of occupants are dissatisfied with thermal comfort in the building. This plan should include measurement of relevant environmental variables in problem areas in accordance with ASHRAE Standard 55-2004 (with errata but without addenda¹).

Residential projects are not eligible for this credit.



Alternative Compliance Path for Projects Outside the U.S.

Achieve IEQ Credit 7.1: Thermal Comfort—Design

Provide a permanent monitoring system to ensure that building performance meets the desired comfort criteria as determined by IEQ Credit 7.1: Thermal Comfort—Design.

Agree to conduct a thermal comfort survey of building occupants within 6 to 18 months after occupancy. This survey should collect anonymous responses about thermal comfort in the building, including an assessment of overall satisfaction with thermal performance and identification of thermal comfort problems. Agree to develop a plan for corrective action if the survey results indicate that more than 20% of occupants are dissatisfied with thermal comfort in the building. This plan should include measurement of relevant environmental variables in problem areas in accordance with International Organization for Standardization (ISO) 7730 Ergonomics of the thermal environment, Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria; and CEN Standard EN 15251, Indoor environmental input parameters for design and assessment of energy performance of buildings addressing indoor air quality, thermal environment, lighting and acoustics, or a local equivalent standard.

Residential projects are not eligible for this credit.

Potential Technologies & Strategies

ASHRAE 55-2004 provides guidance for establishing thermal comfort criteria and documenting and validating building performance to the criteria. While the standard is not intended for purposes of continuous monitoring and maintenance of the thermal environment, the principles expressed in the standard provide a basis for the design of monitoring and corrective action systems.

¹ Project teams wishing to use ASHRAE approved addenda for the purposes of this credit may do so at their discretion. Addenda must be applied consistently across all LEED credits.

IEQ Credit 8.1: Daylight and Views—Daylight

1 Point

Intent

To provide building occupants with a connection between indoor spaces and the outdoors through the introduction of daylight and views into the regularly occupied areas of the building.

Requirements

Through 1 of the 4 options, achieve daylighting in at least the following spaces¹:

Regularly Occupied Spaces	Points
75%	1

OPTION 1. Simulation

Demonstrate through computer simulation that the applicable spaces achieve daylight illuminance levels of a minimum of 10 footcandles (fc) (108 lux) and a maximum of 500 fc (5,400 lux) in a clear sky condition on September 21 at 9 a.m. and 3 p.m.

Provide glare control devices to avoid high-contrast situations that could impede visual tasks. However, designs that incorporate view-preserving automated shades for glare control may demonstrate compliance for only the minimum 10 fc (108 lux) illuminance level.

OR

OPTION 2. Prescriptive

Use a combination of sidelighting and/or toplighting to achieve a total daylighting zone (the floor area meeting the following requirements) that is at least 75% of all the regularly occupied spaces.


For sidelighting zones:

- Achieve a value, calculated as the product of the visible light transmittance (VLT) and window-to-floor area ratio (WFR) of daylight zone between 0.150 and 0.180.

$$0.150 < \text{VLT} \times \text{WFR} < 0.180$$

- The window area included in the calculation must be at least 30 inches (0.8 meters) above the floor.
- In section, the ceiling must not obstruct a line that extends from the window-head to a point on the floor that is located twice the height of the window-head from the exterior wall as measured perpendicular to the glass (see diagram on the next page).


¹ Exceptions for areas where tasks would be hindered by the use of daylight will be considered on their merits.

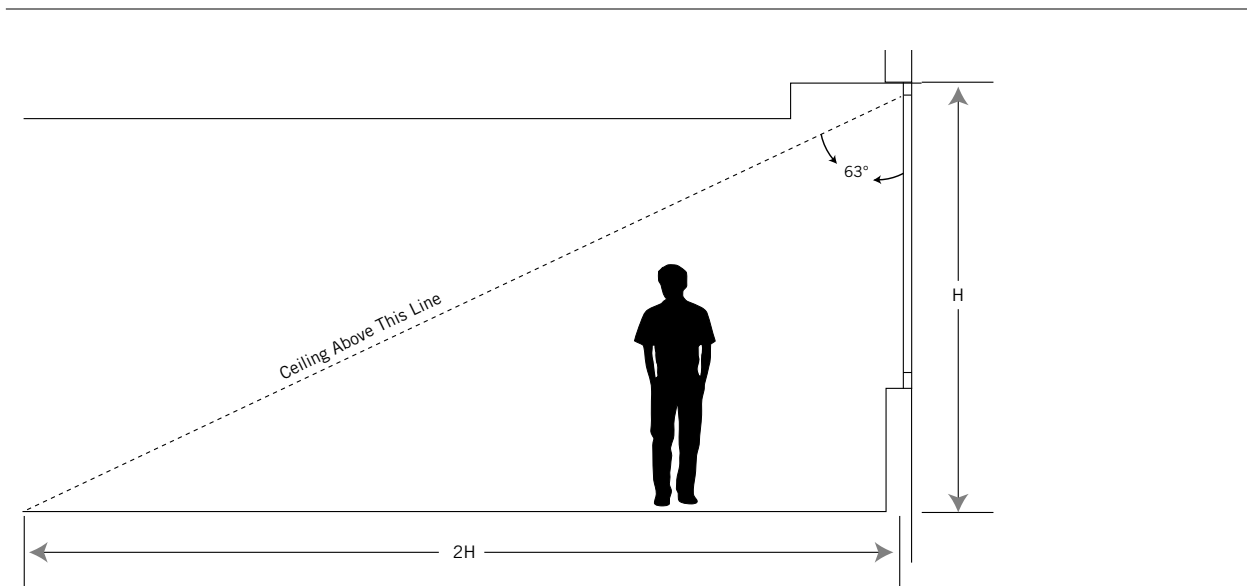

- Provide glare control devices to avoid high-contrast situations that could impede visual tasks. However, designs that incorporate view-preserving automated shades for glare control may demonstrate compliance for only the minimum 0.150 value.

For toplighting zones:

- The toplighting zone under a skylight is the outline of the opening beneath the skylight, plus in each direction the lesser of (see diagram below):
 - 70% of the ceiling height,
 - 1/2 the distance to the edge of the nearest skylight,
 - The distance to any permanent partition that is closer than 70% of the distance between the top of the partition and the ceiling.

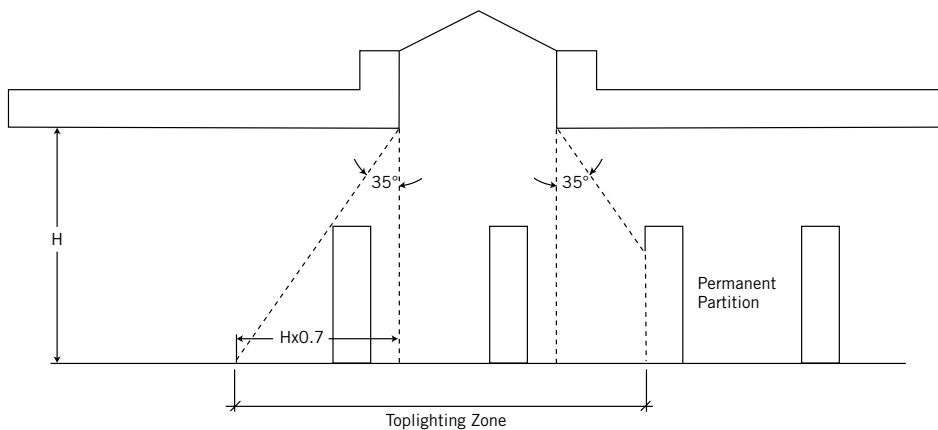

-
- Achieve skylight coverage for the applicable space (containing the toplighting zone) between 3% and 6% of the total floor area.
 - The skylight must have a minimum 0.5 VLT.
 - A skylight diffuser, if used, must have a measured haze value of greater than 90% when tested according to ASTM D1003.

OR

OPTION 3. Measurement

Demonstrate through records of indoor light measurements that a minimum daylight illumination level of 10 fc (108 lux) and a maximum of 500 fc (5,400 lux) has been achieved in applicable spaces. Measurements must be taken on a 10-foot (3-meter) grid and shall be recorded on building floor plans.

Provide glare control devices to avoid high-contrast situations that could impede visual tasks. However, designs that incorporate view-preserving automated shades for glare control may demonstrate compliance for only the minimum 10 fc (108 lux) illuminance level.

OR

OPTION 4. Combination

Any of the above calculation methods may be combined to document the minimum daylight illumination in the applicable spaces.

Potential Technologies & Strategies

Design the building to maximize interior daylighting. Strategies to consider include building orientation, shallow floor plates, increased building perimeter, exterior and interior permanent shading devices, high-performance glazing, and high-ceiling reflectance values; ly, additionally, automatic photocell-based controls can help to reduce energy use. Predict daylight factors via manual calculations or model daylighting strategies with a physical or computer model to assess footcandle (lux) levels and daylight factors achieved.

IEQ Credit 8.2: Daylight and Views—Views

1 Point

Intent

To provide building occupants a connection to the outdoors through the introduction of daylight and views into the regularly occupied areas of the building.

Requirements

Achieve a direct line of sight to the outdoor environment via vision glazing between 30 inches and 90 inches (between 0.8 meters and 2.3 meters) above the finish floor for building occupants in 90% of all regularly occupied areas. Determine the area with a direct line of sight by totaling the regularly occupied floor area that meets the following criteria:

- In plan view, the area is within sight lines drawn from perimeter vision glazing.
- In section view, a direct sight line can be drawn from the area to perimeter vision glazing.

The line of sight may be drawn through interior glazing. For private offices, the entire floor area of the office may be counted if 75% or more of the area has a direct line of sight to perimeter vision glazing. For multi-occupant spaces, the actual floor area with a direct line of sight to perimeter vision glazing is counted.

Potential Technologies & Strategies

Design the space to maximize daylighting and view opportunities. Strategies to consider include lower partitions, interior shading devices, interior glazing and automatic photocell-based controls.

INNOVATION IN DESIGN

ID Credit 1: Innovation in Design

1–5 Points

Intent

To provide design teams and projects the opportunity to achieve exceptional performance above the requirements set by the LEED Green Building Rating System and/or innovative performance in Green Building categories not specifically addressed by the LEED Green Building Rating System.

Requirements

Credit can be achieved through any combination of the Innovation in Design and Exemplary Performance paths as described below:

PATH 1. Innovation in Design (1-5 points)

Achieve significant, measurable environmental performance using a strategy not addressed in the LEED 2009 for New Construction and Major Renovations Rating System.

One point is awarded for each innovation achieved. No more than 5 points under IDc1 may be earned through PATH 1—Innovation in Design.

Identify the following in writing:

- The intent of the proposed innovation credit.
- The proposed requirement for compliance.
- The proposed submittals to demonstrate compliance.
- The design approach (strategies) used to meet the requirements.

PATH 2. Exemplary Performance (1-3 points)

Achieve exemplary performance in an existing LEED 2009 for New Construction and Major Renovations prerequisite or credit that allows exemplary performance as specified in the LEED Reference Guide for Green Building Design & Construction, 2009 Edition. An exemplary performance point may be earned for achieving double the credit requirements and/or achieving the next incremental percentage threshold of an existing credit in LEED.

One point is awarded for each exemplary performance achieved. No more than 3 points under IDc1 may be earned through PATH 2—Exemplary Performance.

PATH 3. Pilot Credit (1-5 points)

Attempt a pilot credit available in the Pilot Credit Library at www.usgbc.org/pilotcreditlibrary. Register as a pilot credit participant and complete the required documentation. Projects may pursue up to 5 Pilot Credits total.

Potential Technologies & Strategies

Substantially exceed a LEED 2009 for New Construction and Major Renovations performance credit such as energy performance or water efficiency. Apply strategies or measures that demonstrate a comprehensive approach and quantifiable environment and/or health benefits.

ID Credit 2: LEED Accredited Professional

1 Point

Intent

To support and encourage the design integration required by LEED to streamline the application and certification process.

Requirements

At least 1 principal participant of the project team shall be a LEED Accredited Professional (AP).

Potential Technologies & Strategies

Educate the project team members about green building design and construction, the LEED requirements and application process early in the life of the project. Consider assigning integrated design and construction process facilitation to the LEED AP.

REGIONAL PRIORITY

RP Credit 1: Regional Priority

1–4 Points

Intent

To provide an incentive for the achievement of credits that address geographically-specific environmental priorities.

Requirements

Earn 1-4 of the 6 Regional Priority credits identified by the USGBC regional councils and chapters as having environmental importance for a project's region. A database of Regional Priority credits and their geographic applicability is available on the USGBC website, <http://www.usgbc.org>.

One point is awarded for each Regional Priority credit achieved; no more than 4 credits identified as Regional Priority credits may be earned. The USGBC has prioritized credits for projects located in the U.S., Puerto Rico, the U.S. Virgin Islands, and Guam. All other international projects should check the database for eligible Regional Priority credits.

Potential Technologies & Strategies

Determine and pursue the prioritized credits for the project location.