

**Environmental
Product
Declaration**

according to ISO 14025 and EN 15804



This declaration is for:
Dulux Trade Sterishield Diamond Matt

Provided by:
AkzoNobel Decorative Paints



program operator
Stichting MRPI®
publisher
Stichting MRPI®
www.mrpi.nl

MRPI® registration
1.1.00379.2022
date of first issue
04-09-2017
date of this issue
11-11-2022
expiry date
11-11-2027





COMPANY INFORMATION



AkzoNobel Decorative Paints
Wexham Road
SL2 5DS
Slough, England
0333 222 70 70

<https://www.akzonobel.com>

PRODUCT

Dulux Trade Sterishield Diamond Matt

DECLARED UNIT/FUNCTIONAL UNIT

All impacts are calculated using the declared unit
"decoration of 1 m² of surface"

DESCRIPTION OF PRODUCT

Dulux Trade Sterishield Diamond Matt is a quick drying, water-based coating containing an in-film bactericide, which inhibits bacteria and reduces populations of MRSA and E. coli

VISUAL PRODUCT



MORE INFORMATION

<https://www.duluxtradepaintexpert.co.uk/en/products/dulux-trade-sterishield-diamond-matt>

MRPI® REGISTRATION

1.1.00379.2022

DATE OF ISSUE

11-11-2022

EXPIRY DATE

11-11-2027

SCOPE OF DECLARATION

This MRPI®-EPD certificate is verified by **ing. Kamiel Jansen, Aveco de Bondt**.

The LCA study has been done by **Mart van Assem & Jur Remeijn, Ecomatters**.

The certificate is based on an LCA-dossier according to ISO14025 and EN15804+A2. It is verified according to the 'MRPI®-EPD verification protocol November 2020.v4.0'. EPDs of construction products may not be comparable if they do not comply with EN15804+A2. Declaration of SVHC that are listed on the 'Candidate List of Substances of Very High Concern for authorisation' when content exceeds the limits for registration with ECHA.

PROGRAM OPERATOR

Stichting MRPI®
Kingsfordweg 151
1043GR
Amsterdam



ir. J-P den Hollander, Managing director MRPI®

DEMONSTRATION OF VERIFICATION

CEN standard EN15804 serves as the core PCR[a]

Independent verification of the declaration and data,

according to EN ISO 14025:2010:

internal: external: X

Third party verifier:



ing. Kamiel Jansen, Aveco de Bondt

[a] PCR = Product Category Rules



DETAILED PRODUCT DESCRIPTION

Sterishield Diamond Matt from Dulux Trade is a quick drying, water-based coating containing an in-film bactericide, which inhibits bacteria and reduces populations of MRSA and E. coli. When combined with appropriate cleaning practices, Sterishield Diamond Matt from Dulux Trade helps to promote a more hygienic environment. It is a tough, scrubbable, durable, stain resistant matt emulsion and is suitable for all normal interior wall and ceiling surfaces. Sterishield Diamond Matt from Dulux Trade is not a substitute for good hygiene practice.

Typical Use

Suitable for use on normal interior wall and ceiling surfaces.

Application Method

Brush, roller, airless spray or conventional spray.

As with other water-based paints, do not use when the temperature is below 8°C (as recommended by British Standard BS6150).

Pack Size


The products are packed in packaging with a capacity of 5L.

Production process and conditions of delivery

During paint production, the raw materials are pre-weighed according to the percentage of each in the formulation. The pigment is then dispersed in a mixture of binder and solvent using a variety of machines. The amount and type of dispersion is product specific and depends on the type of finish required. Finally, tinter is added to correct the colour, the paint is thinned to viscosity, filtered and filled into the appropriate packaging container. All paint containers are transported from the production sites to a distribution center and finally to the customers in the UK.

| COMPONENT >1% of total mass | [kg / %] |
|-----------------------------|--------------|
| Pigments | Confidential |
| Binder | Confidential |
| Water | Confidential |



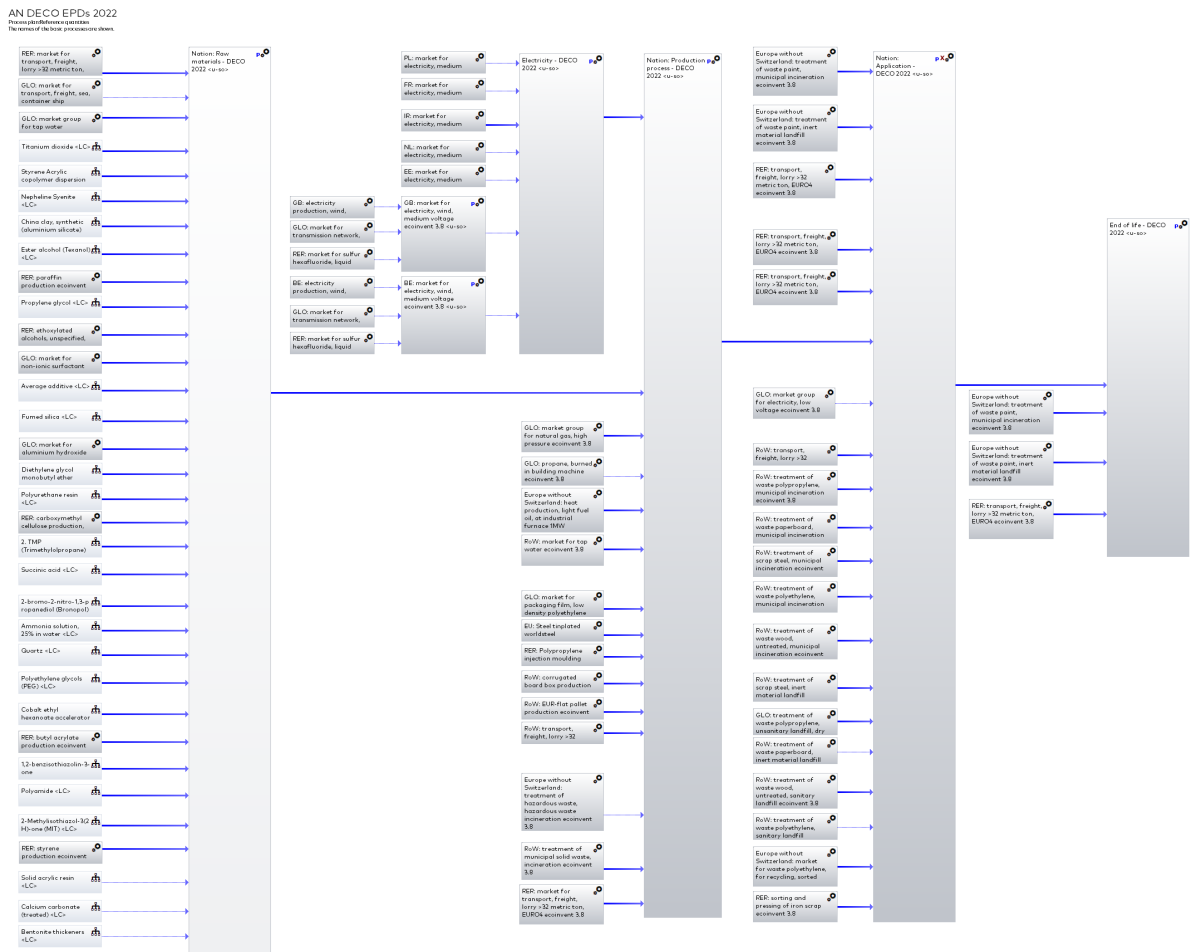

LCA process diagram according to EN 15804 (7.2.1)

REPRESENTATIVENESS

This EPD is representative for the 4 paint products belonging to the Dulux Trade Sterishield Diamond Matt:

1. Dulux Trade Sterishield Diamond Matt Pure Brilliant White
2. Dulux Trade Sterishield Diamond Matt Extra Deep Base
3. Dulux Trade Sterishield Diamond Matt Light Base
4. Dulux Trade Sterishield Diamond Matt Medium Base

This EPD is representative for the products manufactured in Ireland and sold in the UK. The paint is produced at one production site: Cork, Ireland

ENVIRONMENTAL IMPACT per functional unit or declared unit (core indicators A2)

| | UNIT | A1 | A2 | A3 | A1-A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
|-----------------------|-------------------------|-------------|-------------|--------------|--------------|-------------|--------------|------|------|------|------|------|------|------|------|--------------|------|--------------|------|
| GWP-total | kg CO2 eq. | 2.91 E-1 | 7.33 E-3 | 2.21 E-2 | 3.20 E-1 | 1.61 E-2 | 1.26 E-2 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.25 E-3 | 0.00 | 5.06 E-2 | 0.00 |
| GWP-fossil | kg CO2 eq. | 2.90 E-1 | 7.30 E-3 | 3.91 E-2 | 3.36 E-1 | 1.60 E-2 | 8.17 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.24 E-3 | 0.00 | 5.06 E-2 | 0.00 |
| GWP-biogenic | kg CO2 eq. | 6.49 E-4 | 2.67 E-5 | -1.70 E-2 | -1.63 E-2 | 5.86 E-5 | 4.40 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 4.54 E-6 | 0.00 | 8.24 E-6 | 0.00 |
| GWP-luluc | kg CO2 eq. | 2.32 E-4 | 2.73 E-6 | 1.86 E-5 | 2.53 E-4 | 5.99 E-6 | 4.47 E-7 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 4.65 E-7 | 0.00 | 9.11 E-7 | 0.00 |
| ODP | kg CFC11 eq. | 2.29 E-8 | 1.76 E-9 | 1.40 E-9 | 2.61 E-8 | 3.86 E-9 | 7.87 E-11 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.99 E-10 | 0.00 | 3.69 E-10 | 0.00 |
| AP | mol H+ eq. | 2.06 E-3 | 3.71 E-5 | 1.20 E-4 | 2.22 E-3 | 8.15 E-5 | 3.87 E-6 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 6.32 E-6 | 0.00 | 1.19 E-5 | 0.00 |
| EP-freshwater | kg PO4 eq. | 5.00 E-5 | 4.59 E-7 | 1.12 E-6 | 5.16 E-5 | 1.01 E-6 | 1.49 E-7 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 7.81 E-8 | 0.00 | 1.41 E-7 | 0.00 |
| EP-marine | kg N eq. | 2.99 E-4 | 1.28 E-5 | 2.76 E-5 | 3.39 E-4 | 2.80 E-5 | 2.36 E-6 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.17 E-6 | 0.00 | 4.59 E-6 | 0.00 |
| EP-terrestrial | mol N eq. | 3.13 E-3 | 1.39 E-4 | 2.85 E-4 | 3.55 E-3 | 3.06 E-4 | 1.37 E-5 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.37 E-5 | 0.00 | 5.02 E-5 | 0.00 |
| POCP | kg NMVOC eq. | 1.04 E-3 | 4.16 E-5 | 9.08 E-5 | 1.17 E-3 | 9.14 E-5 | 1.28 E-4 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 7.09 E-6 | 0.00 | 1.37 E-5 | 0.00 |
| ADP-minerals & metals | kg Sb eq. | 4.11 E-7 | 1.69 E-8 | 3.48 E-8 | 4.62 E-7 | 3.71 E-8 | 1.70 E-8 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.88 E-9 | 0.00 | 3.17 E-9 | 0.00 |
| ADP-fossil | MJ, net calorific value | 4.48 E+0 | 1.15 E-1 | 4.96 E-1 | 5.09 E+0 | 2.53 E-1 | 6.78 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.96 E-2 | 0.00 | 2.72 E-2 | 0.00 |
| WDP | m3 world eq. deprived | 9.66 E+0 | 5.87 E-4 | 3.68 E-3 | 9.66 E+0 | 1.29 E-3 | 1.09 E-4 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 9.99 E-5 | 0.00 | 1.20 E-3 | 0.00 |

- GWP-total = Global Warming Potential total
- GWP-fossil = Global Warming Potential fossil fuels
- GWP-biogenic = Global Warming Potential biogenic
- GWP-luluc = Global Warming Potential land use and land use change
- ODP = Depletion potential of the stratospheric ozone layer
- AP = Acidification Potential, Accumulated Exceedence
- EP-freshwater = Eutrophication Potential, fraction of nutrients reaching freshwater end compartment
- EP-marine = Eutrophication Potential, fraction of nutrients reaching marine end compartment
- EP-terrestrial = Eutrophication Potential, Accumulated Exceedence
- POCP = Formation potential of tropospheric ozone photochemical oxidants
- ADP-minerals&metals = Abiotic Depletion Potential for non fossil resources [2]
- ADP-fossil = Abiotic Depletion for fossil resources potential [2]
- WDP = Water (user) deprivation potential, deprivation-weighted water consumption [2]

Disclaimer [2]

- The results of this environmental impact indicator shall be used with care as the uncertainties on these results are high or as there is limited experience with the indicator.

ENVIRONMENTAL IMPACT per functional unit or declared unit (additional indicators A2)

| | UNIT | A1 | A2 | A3 | A1-A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
|--------|-------------------|--------------|--------------|--------------|--------------|--------------|--------------|------|------|------|------|------|------|------|------|--------------|------|--------------|------|
| PM | Disease incidence | 3.38 E-8 | 6.78 E-10 | 1.43 E-9 | 3.60 E-8 | 1.49 E-9 | 5.42 E-11 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.15 E-10 | 0.00 | 1.81 E-10 | 0.00 |
| IRP | kBq U235 eq. | 3.19 E-2 | 5.80 E-4 | 1.15 E-3 | 3.36 E-2 | 1.27 E-3 | 3.92 E-5 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 9.89 E-5 | 0.00 | 1.14 E-4 | 0.00 |
| ETP-fw | CTUe | 2.36 E+1 | 9.29 E-2 | 2.18 E-1 | 2.39 E+1 | 2.04 E-1 | 2.43 E+0 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.58 E-2 | 0.00 | 2.76 E-2 | 0.00 |
| HTP-c | CTUh | 4.78 E-10 | 2.48 E-12 | 3.84 E-11 | 5.19 E-10 | 5.44 E-12 | 6.89 E-12 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 4.22 E-13 | 0.00 | 6.43 E-11 | 0.00 |
| HTP-nc | CTUh | 4.02 E-8 | 8.50 E-11 | 3.82 E-10 | 4.07 E-8 | 1.87 E-10 | 6.62 E-11 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.45 E-11 | 0.00 | 2.04 E-10 | 0.00 |
| SQP | --- | 6.06 E-1 | 1.31 E-1 | 1.47 E+0 | 2.21 E+0 | 2.88 E-1 | 9.52 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.23 E-2 | 0.00 | 4.86 E-2 | 0.00 |

PM = Potential incidence of disease due to PM emissions

IRP = Potential Human exposure efficiency relative to U235 [1]

ETP-fw = Potential Comparative Toxic Unit for ecosystems [2]

HTP-c = Potential Comparative Toxic Unit for humans [2]

HTP-nc = Potential Comparative Toxic Unit for humans, non-cancer [2]

SQP = Potential soil quality index [2]

Disclaimer [1]

- This impact category deals mainly with the eventual impact of low dose ionizing radiation on human health of the nuclear fuel cycle. It does not consider effects due to possible nuclear accidents, occupational exposure nor due to radioactive waste disposal in underground facilities. Potential ionizing radiation from the soil, from radon and from some construction materials is also not measured by this indicator.

Disclaimer [2]

- The results of this environmental impact indicator shall be used with care as the uncertainties on these results are high or as there is limited experience with the indicator.

RESOURCE USE per functional unit or declared unit (A1 / A2)

| | UNIT | A1 | A2 | A3 | A1-A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
|-------|------|-------------|--------------|-------------|-------------|-------------|--------------|------|------|------|------|------|------|------|------|--------------|------|--------------|------|
| PERE | MJ | 1.15 E-1 | 1.47 E-3 | 2.03 E-1 | 3.20 E-1 | 3.22 E-3 | 3.69 E-4 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.50 E-4 | 0.00 | 3.16 E-4 | 0.00 |
| PERM | MJ | 1.24 E-4 | 6.84 E-10 | 1.31 E-4 | 2.55 E-4 | 1.50 E-9 | 1.38 E-10 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.16 E-10 | 0.00 | 5.23 E-10 | 0.00 |
| PERT | MJ | 1.15 E-1 | 1.47 E-3 | 2.03 E-1 | 3.20 E-1 | 3.22 E-3 | 3.69 E-4 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.50 E-4 | 0.00 | 3.16 E-4 | 0.00 |
| PENRE | MJ | 4.48 E+0 | 1.15 E-1 | 4.96 E-1 | 5.09 E+0 | 2.53 E-1 | 6.78 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.96 E-2 | 0.00 | 2.72 E-2 | 0.00 |
| PENRM | MJ | 1.47 E-6 | 0.00 | 1.61 E-9 | 1.47 E-6 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| PENRT | MJ | 4.48 E+0 | 1.15 E-1 | 4.96 E-1 | 5.10 E+0 | 2.53 E-1 | 6.78 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.96 E-2 | 0.00 | 2.72 E-2 | 0.00 |
| SM | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| RSF | MJ | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| NRSF | MJ | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| FW | m3 | 2.25 E-1 | 1.37 E-5 | 9.48 E-5 | 2.25 E-1 | 3.00 E-5 | 2.55 E-6 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 2.33 E-6 | 0.00 | 2.79 E-5 | 0.00 |

PERE = Use of renewable energy excluding renewable primary energy resources

PERM = Use of renewable energy resources used as raw materials

PERT = Total use of renewable primary energy resources

PENRE = Use of non-renewable primary energy resources excluding non-renewable energy resources used as raw materials

PENRM = Use of non-renewable primary energy resources used as raw materials

PENRT = Total use of non-renewable primary energy resources

SM = Use of secondary materials

RSF = Use of renewable secondary fuels

NRSF = Use of non renewable secondary fuels

FW = Use of net fresh water

OUTPUT FLOWS AND WASTE CATEGORIES per functional unit or declared unit (A1 / A2)

| | UNIT | A1 | A2 | A3 | A1-A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
|------|------|------|------|-------------|-------------|------|-------------|------|------|------|------|------|------|------|------|------|------|-------------|------|
| HWD | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| NHWD | kg | 0.00 | 0.00 | 1.41 E-3 | 1.41 E-3 | 0.00 | 1.32 E-2 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 1.73 E-1 | 0.00 |
| RWD | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| CRU | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| MFR | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 5.47 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| MER | kg | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| EEE | MJ | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| ETE | MJ | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

HWD = Hazardous Waste Disposed

RWD = Radioactive Waste Disposed

MFR = Materials for recycling

EEE = Exported Electrical Energy

NHWD = Non Hazardous Waste Disposed

CRU = Components for reuse

MER = Materials for energy recovery

ETE = Exported Thermal Energy

BIOGENIC CARBON CONTENT per functional unit or declared unit (A1 / A2)

| | UNIT | A1 | A2 | A3 | A1-A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
|-------|------|------|------|--------------|--------------|------|-------------|------|------|------|------|------|------|------|------|------|------|------|------|
| BCCpr | kg C | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| BCCpa | kg C | 0.00 | 0.00 | -2.77 E-3 | -2.77 E-3 | 0.00 | 2.77 E-3 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

BCCpr = Biogenic carbon content in product
 BCCpa = Biogenic carbon content in packaging

CALCULATION RULES

Cut off criteria

The cut-off is considered in the raw material supply stage (A1). Cut-off of inputs comprises of the raw materials, for which no appropriate proxies were found. In this study there were no cut-off inputs. The energy consumed during application, used for instance in spray applicators, has not been included due to its insignificance. For recycling of waste packaging material (metal and plastic), a cut-off approach was followed. The cut-off point is chosen to be the end of waste treatment.

Data quality and data collection period

Specific data was collected from AkzoNobel through a questionnaire, including inquiries about paint characteristics and packaging, logistics data (e.g. transport), production information and end-of-life. The data collection period for specific data was the year 2022.

Data gaps (i.e. transport data, end of life scenarios) were covered with data generic values for transport as described in the Product Environmental Footprint Category Rules - Decorative Paints document version 1.0 published by CEPE and reviewed in April 2018. Further data gaps (i.e. end-of-life transport data) were covered with data from internal AkzoNobel LCA studies concerning the same type of products (paints and coatings). Generic data (i.e. upstream acquisition and production of raw materials, energy generation, transport, waste treatment processes) was selected from Ecoinvent 3.8 database. In the case of missing data, a relevant proxy was searched and adjusted to the corresponding unit process.

Allocation procedure

To allocate the emissions and inputs to the manufactured products, the decision-hierarchy in ISO 14044 is used (ISO 2006). It is not possible to sub-divide the site data into a more detailed level or find physical causalities between inputs and outputs, thus allocation is done based on mass, considering the annual production of paint product for each site. The paint production is basically a process of mixing ingredients and, therefore, the environmental impact is fairly to be related to the mass of the products.

| Parameter | Unit | Value |
|--------------------|-------------------|---------|
| VOC content | g/l | 4.2 |
| Density | kg/l | 1.38337 |
| Coverage | m ² /l | 16 |
| Number of layers | Quantity | 2 |
| Total product used | kg/m ² | 0.173 |

SCENARIOS AND ADDITIONAL TECHNICAL INFORMATION

A1. Raw materials supply

This module considers the extraction and processing of all raw materials and energy which occur upstream to the Dulux Trade Sterishield Diamond Matt manufacturing process, as well as waste processing up to the end-of waste state.

A2. Transport of raw materials to manufacturer

This includes the transport distance of the raw materials to the manufacturing facility via road.

| Vehicle type used for transport | Truck |
|---|--------------------|
| Distance, km | 460 |
| Capacity | >32 t ,64% payload |
| Bulk density of transported products, kg/m3 | 1441 kg/m3 |

A3. Manufacturing

This module covers the manufacturing of the Dulux Trade Sterishield Diamond Matt and includes all processes linked to production such as storing, mixing, packing and internal transportation. Use of electricity, fuels and auxiliary materials in paint production is taken into account as well.

Data regarding paint production was provided for the manufacturing site where the Dulux Trade Sterishield Diamond Matt is produced: Cork, Ireland. Furthermore, the specific transportation distances and transportation modes for raw materials, paint packaging and transportation to customer were collected from the AkzoNobel logistics department. Primary data and site-specific data were retrieved. For electricity sources (standard market mix, Ireland) the Ecoinvent 3.8 dataset was used. For upstream (raw material processes) and downstream processes (application, use, and waste processing) generic data is used when no specific data is obtained.

The construction site data includes lighting, heating, offices, etc. The manufacture of production equipment and infrastructure is not included in the system boundary.

A4. Transport to Regional Distribution Centre and customer

All paint containers are transported from the production facility into a distribution centre and then finally to the customer. On average, the transport characteristics for this life cycle stage are the following

| Coatings transport type | Transport from factory to | |
|--------------------------------------|---------------------------|---------------------------|
| | RDC | Transport from RDC to PoS |
| Transport Type | Truck | Truck |
| Distance (km) | 783 | 227.2 |
| Capacity | >32 t, 60% payload | >32 t, 60% payload |
| Bulk density of transported products | 1441 kg/m3 | 1441 kg/m3 |

A5. Application and use

This module includes the environmental aspects and impacts associated with the application and of the paint. It is assumed that no energy is required during the application of this paint. The use of paintbrushes and other appliances used during application are not included. There are some raw materials added in the paint formulations which contain small amounts of solvents. The VOC emissions during application of paint are included in this module.

C2. Transport to incineration or landfill

This module includes one-way transportation distance of the demolition or sorting site to the dump site.

| End-of-life transport type | Transport to waste processing |
|--------------------------------------|-------------------------------------|
| Vehicle type | Truck 34t-40t payload average fleet |
| Distance | 80 km |
| Capacity utilisation | 60% |
| Bulk density of transported products | 1040 kg/m3 |

C3. Waste processing and C4. Disposal

The end of life stage is encompassed in these modules. It is assumed that paint is used as interior paint and exterior paint. In both cases, it is assumed that part of the paint is lost during application and the rest is applied.

| Classification of paint, based on function | % of sold paint to landfill | % of sold paint to incineration |
|--|-----------------------------|---------------------------------|
| Interior Masonry Wall | 88% | 12% |
| Exterior, Trim and other paints | 88% | 12% |



DECLARATION OF SVHC

None of the substances contained in the product are listed in the “Candidate List of Substances of Very High Concern for authorisation”, or they do not exceed the threshold with the European Chemicals Agency.

REFERENCES

- EN 15804:2012+A2:2019 Sustainability of construction works. Environmental product declarations. Core rules for the product category of construction products, of 2019.
- ISO 14040/14044 on Life Cycle Assessments
- Product Environmental Footprint Category Rules - Decorative Paints version 1.0, 2018. Developed by the Technical Secretariat Decorative Paints of the European Council of the Paint, Printing Ink and Artists' Colours Industry.
- Willener, Y, 2022. Personal communication with Yasmine Willener, Commercial Strategy & Planning Project Manager, Akzo Nobel Decorative Paints, UK.
- Thinkstep GaBi Software-System and Database for Life Cycle Engineering. Copyright 1992-2018 ThinkStep AG.
- Wernet, G., Bauer, C., Steubing, B., Reinhard, J., Moreno-Ruiz, E., and Weidema, B., 2016. The ecoinvent database version 3 (part I): overview and methodology. The International Journal of Life Cycle Assessment, [online] 21(9), pp.1218–1230. Available at: <<http://link.springer.com/10.1007/s11367-016-1087-8>> [Accessed 21 12 2021.]

REMARKS

None

